Addendum 1

Alaska Veterans & Pioneer Home Partial Re-roof ANC 17-01C

DRAWINGS:

- 1) Replace sheet A2 with attached sheet A2
- 2) Add General Note 18. to sheet A1:

18. Tenting: Provide tents that keep the roof area being worked on dry. Tents should be able to resist winds to 60 MPH. If stronger winds are predicted, temporarily remove tenting. Provide ventilation of tented area as necessary for worker safety.

3) Add General Note 19. to sheet A1:

19. Dimensional lumber to be Hem-fir No. 2 or better. Plywood to be $\frac{1}{2}$ " APA rated, Exposure 1, minimum 3-plies, and 24/16 rating. Galvanized nails to be used on all roofing related work. Common wire nails ok at window infill 2x framing. Nail size and spacing to conform to Table 2304.0.1 of the IBC.

BID DUE DATE:


Extended from August 2, 2016 @ 2:00 PM to August 5, 2016 @ 2:00 PM

Issue Date: July 28, 2016 Issued By: Mark Moon, Project Manager


Contractor must acknowledge receipt of this addendum on the bid form to avoid being disqualified.

Thank You

James Woods Building Management Specialist HSS/Facilities 907 465-1871 wk 907 465-2499 fax james.woods@alaska.gov

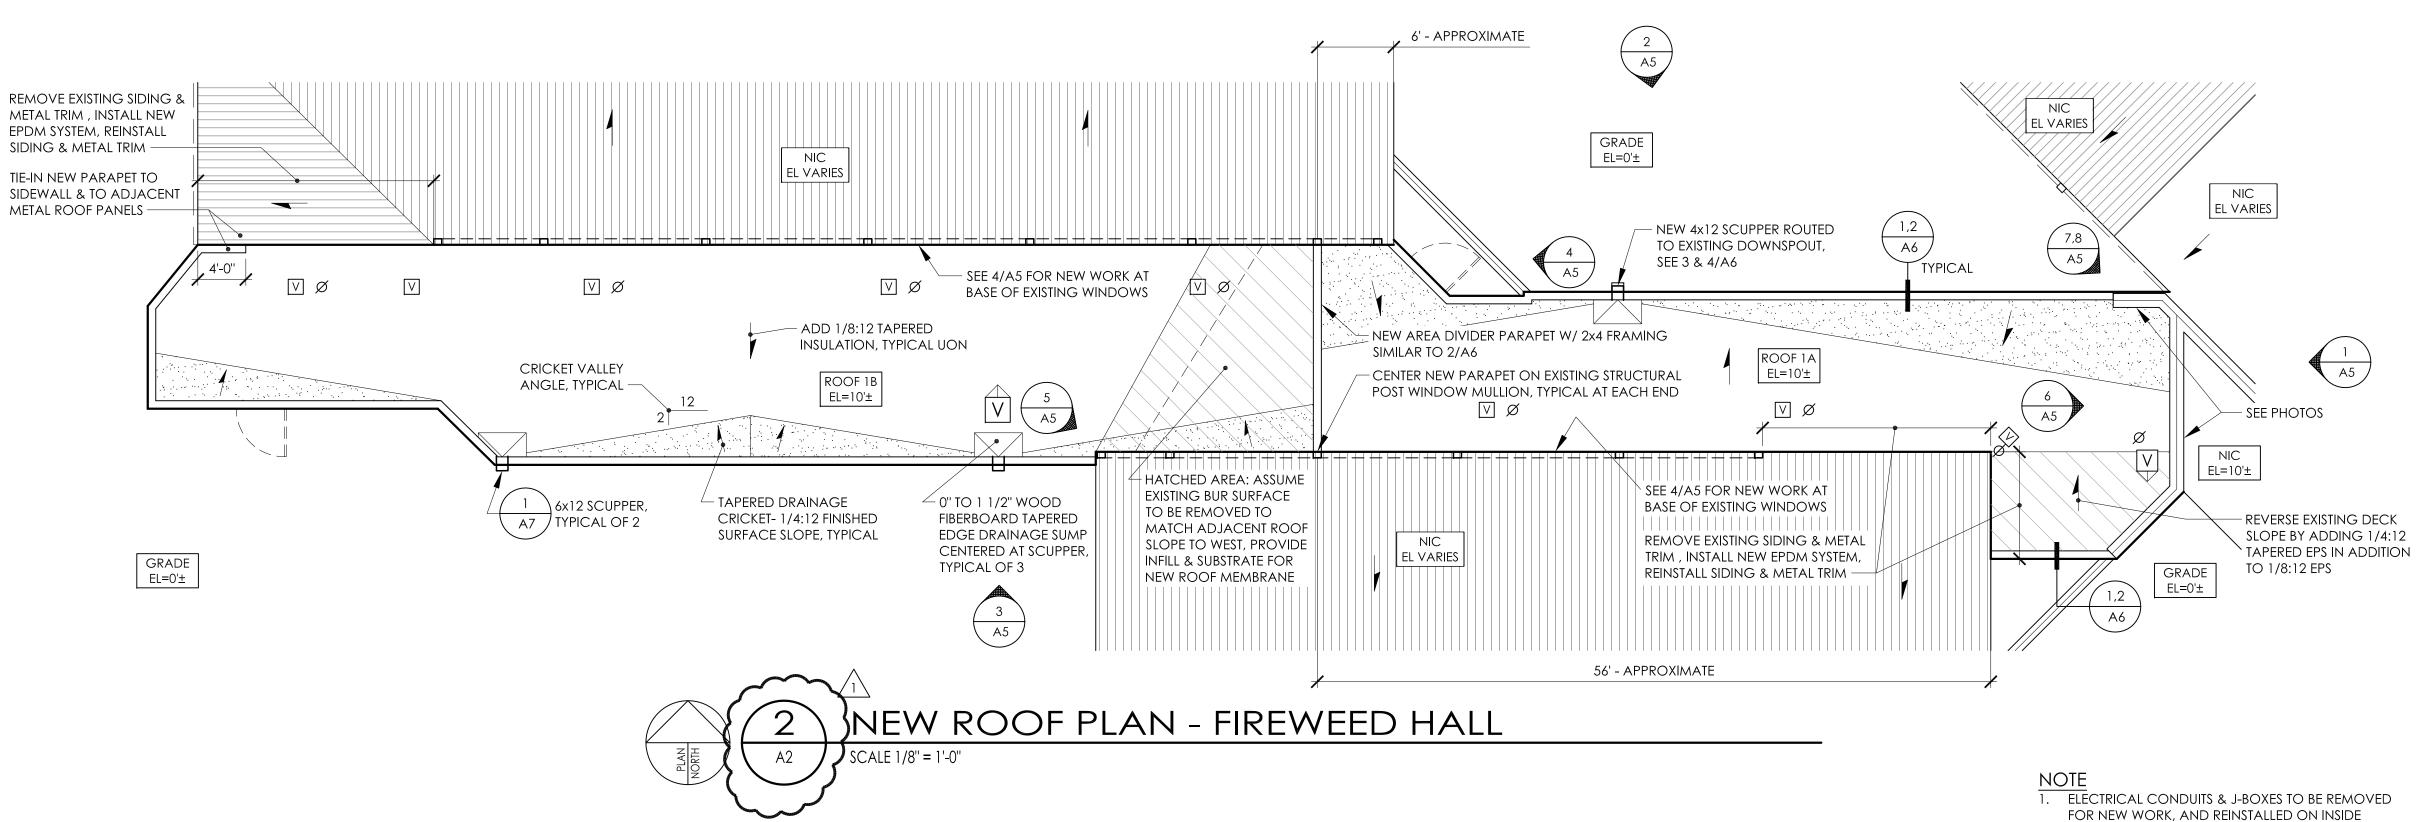



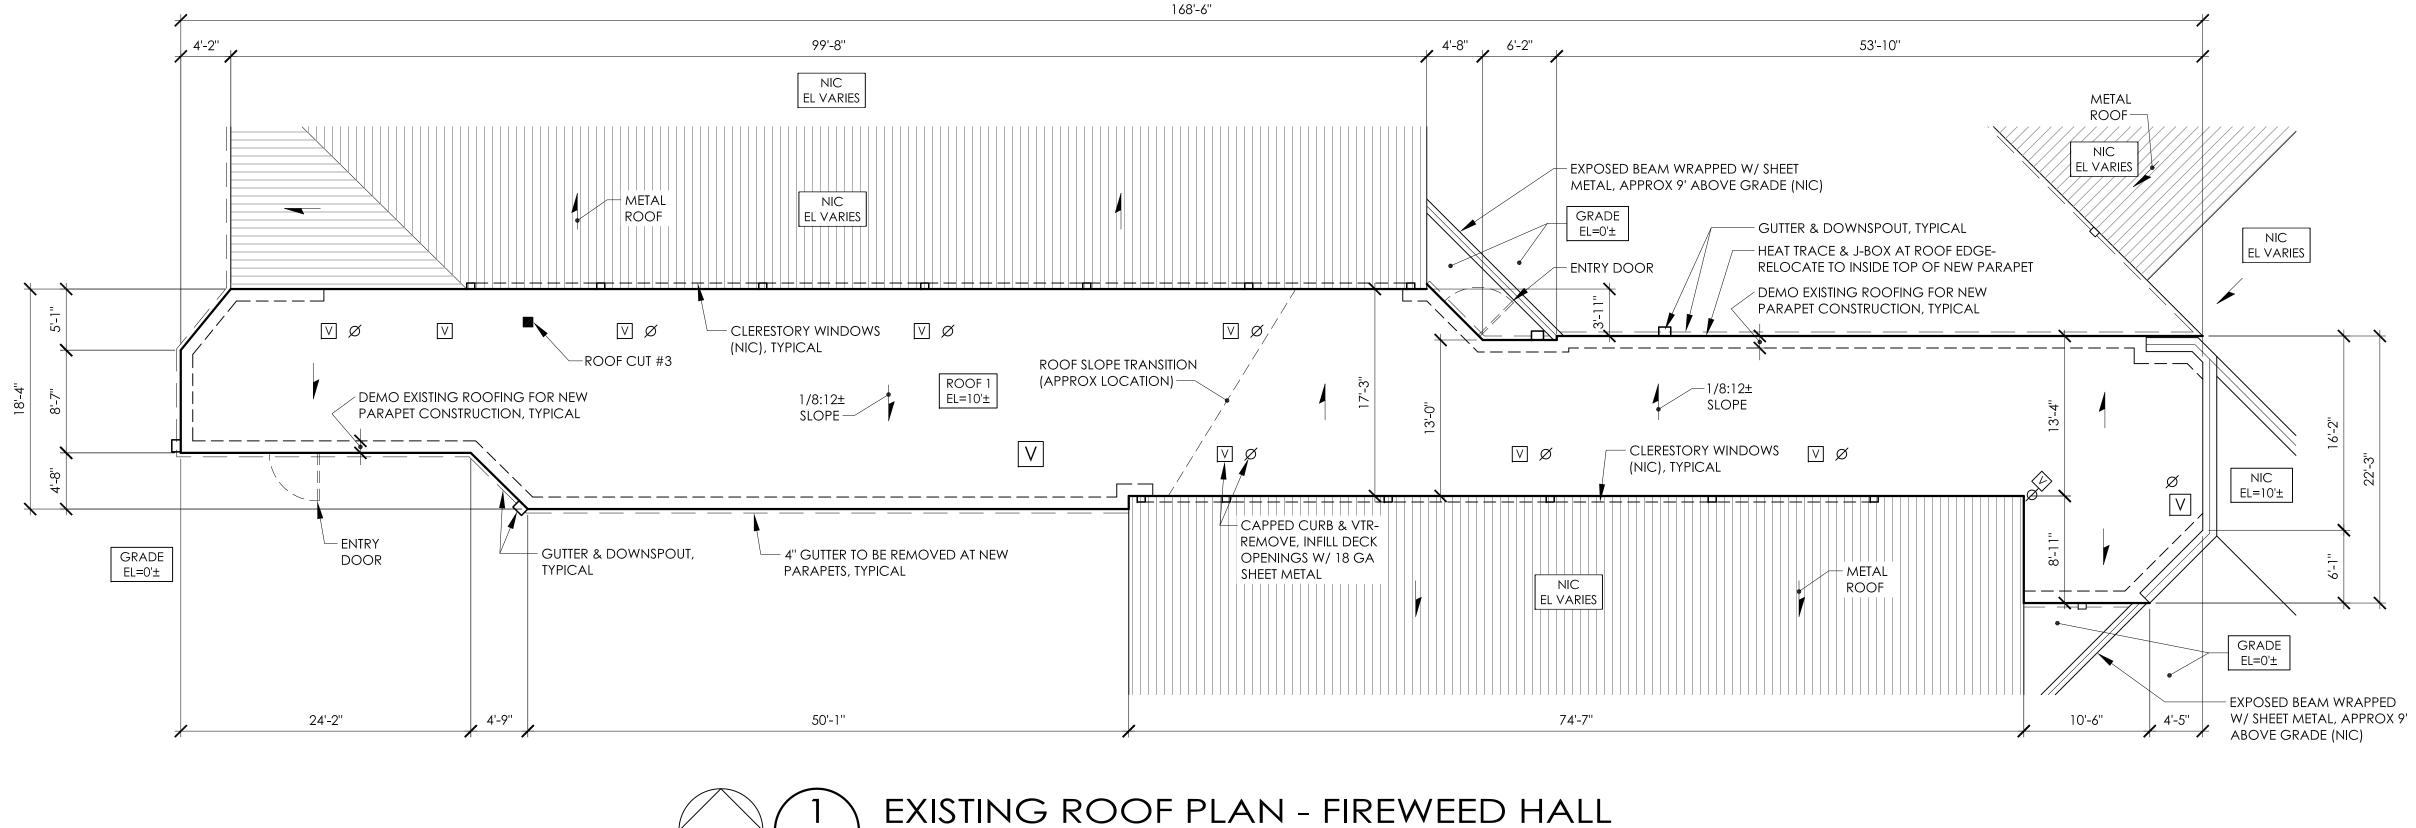

A2

SCALE 1/8" = 1'-0"

FOR NEW WORK, AND REINSTALLED ON INSIDE FACE OF NEW PARAPET. PRE-BID SITE VISIT TO QUANTIFY THIS WORK IS HIGHLY RECOMMENDED.

