





1. ALL CABLING ON THIS DETAIL SHALL BE OFCI. ALL TERMINATIONS SHALL BE PERFORMED BY CONTRACTOR.
2. CONTRACTOR SHALL TERMINATE MICROPHONE CABLING AT JACK LOCATIONS. PROVIDE AND INSTALL MICROPHONE JACKS.
3. PROVIDE FIBER OPTIC BACKBONE CABLE BETWEEN (1) RACK AND TELECOM ROOM.
4. PROVIDE MINIMUM 16"x16"x4"D JUNCTION BOX FOR CABLING TO EACH RACK. FINAL SIZE SHALL BE DETERMINED BY CONTRACTOR BASED ON CONDUIT LAYOUT. BOX SHALL BE SURFACE-MOUNTED BEHIND RACK, IF NEEDED.
5. SPEAKERS SHALL BE OFCI.
6. TO LIGHTING CONTROL STATION NEAR LECTERN. SEE 1/E2.1 FOR LOCATION.
7. DIAGRAM IS TYPICAL OF EACH CLASSROOM. SEE PLANS FOR DEVICE COUNTS AND LOCATIONS.

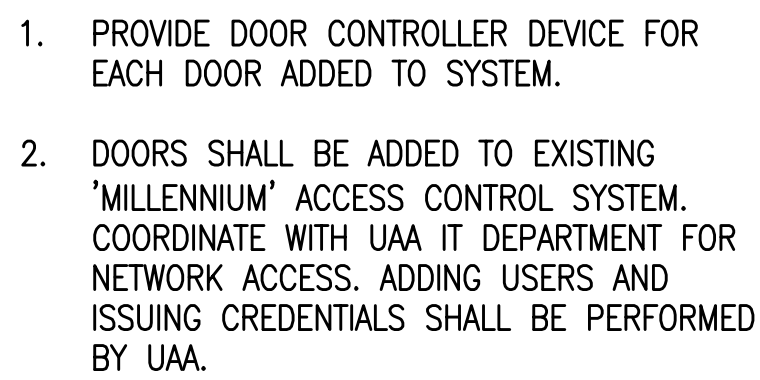

1. SEE 1/E2.1 FOR EXACT FIXTURE COUNT AND LAYOUT.
2. CONTRACTOR SHALL PROGRAM (3) SCENES AND ENGINEER BUTTONS FOR GENERAL, A/V AND WHITEBOARD MODES. CONFIGURATION OF DIMMING LEVELS SHALL BE PERFORMED ON-SITE ONCE LIGHTS ARE INSTALLED. PROVIDE BUTTONS FOR ALL ON (FULL BRIGHTNESS) AND ALL OFF.
3. CONNECT MODULE AND CONTACT PROVIDE CLOSURE INTERFACE TO A/V SYSTEM. INTENT IS FOR THE (3) SCENES DESCRIBED IN NOTE 2 TO BE AVAILABLE THROUGH THE A/V CONTROL SYSTEM.

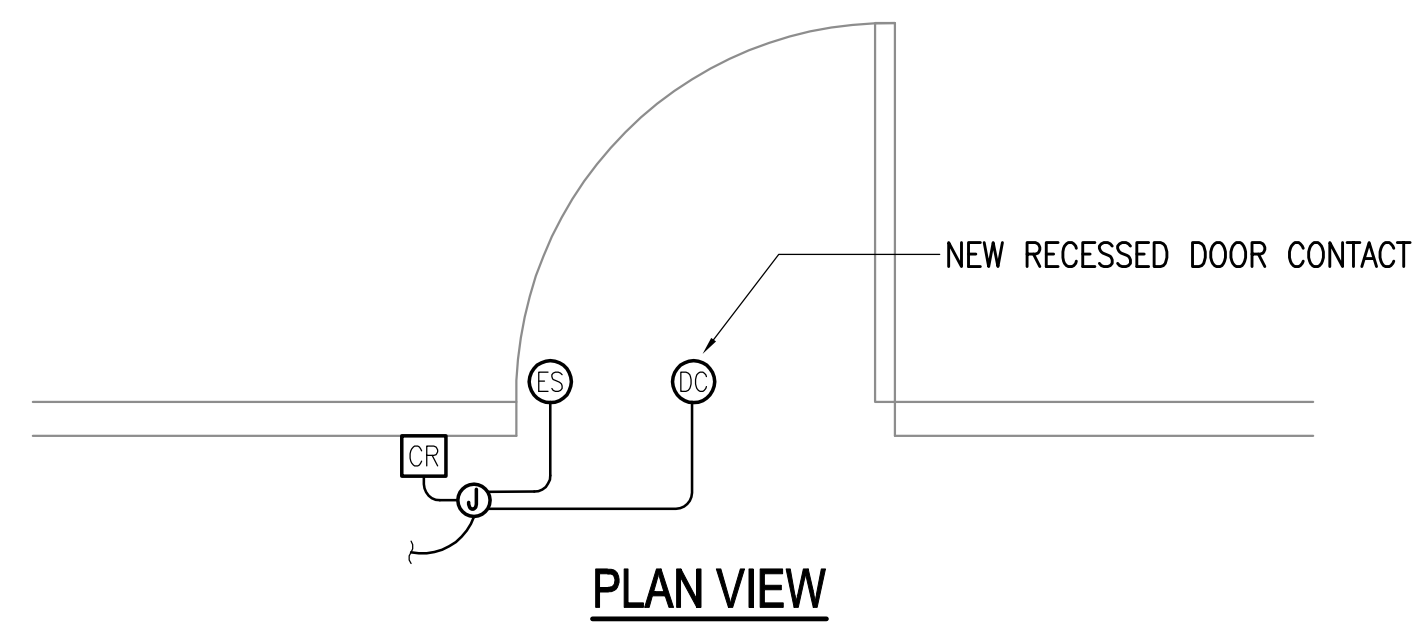

AUTHOR: JAM,RWM CHECKED: JAM,RLW
OWNER PROJECT #: L502.10
ISSUE DATE: 3-14-17
REVISION:

Phase II Doctor of Pharmacy Program Tenant Improvements at the PSB Building

MECHANICAL AND ELECTRICAL CONSULTING ENGINEERS
70 West Fireweed Lane, Suite 200 Anchorage, AK 99503 (907) 276-0521
91 East Swanson Ave., Suite 101 Wasilla, AK 99654 (907) 357-1521
Corporate No.: AEC-5542

3909 Arctic Boulevard, Suite 103
ANCHORAGE, ALASKA 99503 907.561.5543
PROJECT NO. 13-008.11

CONSTRUCTION DOCUMENTS
PROJECT NO. 13-008.111

E5.1