SHEET NOTES

1. EXISTING EXHAUST DUCT TERMINATION THROUGH ROOF CURB TO BE RE-USED FOR NEW EXHAUST.
2. APPROXIMATE NATURAL GAS METER LOCATION AT GROUND LEVEL. REVISE GAS PIPING PER DIAGRAM 2/M501.
3. 1-1/4" NG PIPE DOWN ALONG EXTERIOR WALL TO SERVE MUA-1. PROVIDE EXTERIOR WALL PENETRATION, SEE M202 FOR CONTINUATION.
4. AS-BUILT CONDITIONS ARE BASE UPON ORIGINAL CONSTRUCTION DRAWINGS DATED 10/18/84. FIELD VERIFY.

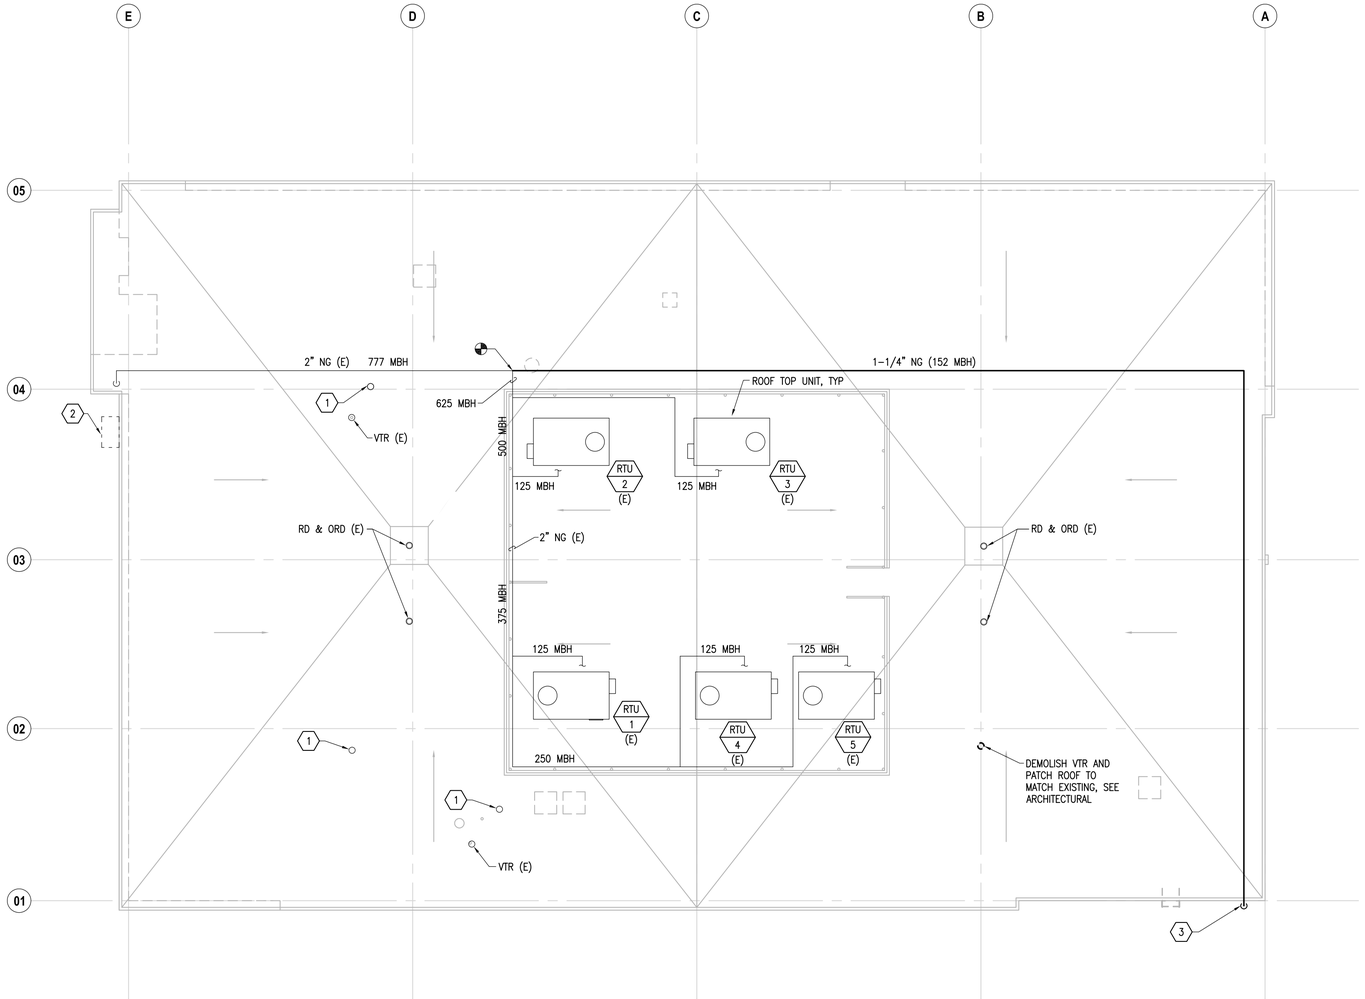

1 / M301 ROOF PLAN – MECHANICAL – DEMO AND NEW

SCALE: 1/8" = 1'-0"

0 4' 8' 16' 24'

RIM ARCHITECTS

ALASKA | HAWAII GUAM CALIFORNIA

645 'G' STREET, SUITE 400
ANCHORAGE, ALASKA 99501
Phone: 907.258.7777
Fax: 907.279.8195
www.rimarchitects.com

STATE OF ALASKA 49TH
Bart A. Semmler
04/07/2017
ME-13385
REGISTERED PROFESSIONAL ENGINEER
© 17605

AMC ENGINEERS
www.amc-engineers.com
Adams, Morgenthaler & Co., Inc.
CoA No. C0342 - 907.257.9100
701 E. Tudor Rd. Suite 250
Anchorage, AK 99503

PROJECT TITLE: UAA ANSEP ULA RENOVATION
ADDRESS: UNIVERSITY LAKE BUILDING - BUILDING AO 107
OWNER: UNIVERSITY OF ALASKA ANCHORAGE
SHEET TITLE: ROOF PLAN - MECHANICAL - DEMO AND NEW

NO	DESCRIPTION	DATE

DATE :	2017.04.07
PROJECT NO :	17-0103
DRAWN BY :	BAS
CHECKED BY :	MDL
COPYRIGHT :	2015 RIM ARCHITECTS

DWG NO: M301

FILE NAME: X:\17605 ANSEP\Dwgs\Mdwg\Sheet Files\17605 - M301.dwg
PLOTTED: BAS 4/7/2017 4:18 PM