SHEET NOTES

1. UON BY LINE WEIGHT AND/OR NOTATION; EXISTING ELECTRICAL SHALL BE REUSED, RELOCATED OR DEMOLISHED PER PLAN, DETAILS, AND DIAGRAMS. COORDINATE WORK WITH MECHANICAL, ARCHITECT, OWNER, AND OTHER TRADES. REFER TO AND COORDINATE WITH THE WORK SHOWN ON NEW PLANS, DETAILS, AND DIAGRAMS. UNUSED CABLES, CONDUIT AND DEVICES AND EQUIPMENT SHALL BE COMPLETELY DEMOLISHED.

(2) ALTERNATE WORK AREA
LIGHTING FIXTURES: UON DEMOLISH EXISTING INTERIOR AND EXTERIOR LIGHTING FIXTURES AND CONTROLS. EXISTING CONDUIT MAY BE REUSED FOR NEW WORK AT CONTRACTOR'S RISK.
EQUIPMENT POWER AND DEVICES: EXISTING EQUIPMENT, DEVICES RECEPTACLES TO REMAIN AND BE RECONNECTED AND REWORKED IAW NEW PLANS. USE CARE AND IDENTIFY/TAG EXISTING BRANCH CIRCUITS WHEN DEMOLISHING EXISTING PANELS. PREP FOR RECONNECTION AND EXTENDING TO NEW PANELS UNDER NEW WORK. EXISTING CONDUIT MAY BE REUSED AT CONTRACTOR'S RISK FOR NEW WORK.
TELECOM OUTLETS: EXISTING TELECOM OUTLETS TO REMAIN AND BE REWORKED IAW NEW PLANS.
ACCESS CONTROL SYSTEM: EXISTING ACCESS CONTROLS SYSTEM INCLUDING DEVICES, CONNECTIONS, WIRING, PANELS, ETC. SHALL REMAIN IN PLACE AND ACTIVE.

(3) SEE ENLARGED PLANS AND POWER ONE-LINE DIAGRAM ON SHEETS E401 AND E501 FOR ELECTRICAL DISTRIBUTION, ELECT ROOM AND COMM ROOM REWORK DETAILS.

(4) EXISTING HORIZONTAL TELECOM CABLING TO DEMOLISHED TELECOM OUTLET MAY BE REUSED FOR NEW TELECOM DROP LOCATIONS ON THE REVISED PLAN. REUSED HORIZONTAL CABLING SHALL BE RE-TERMINATED TO NEW TELECOM JACKS AND THEN RETESTED AND SHALL MEET MINIMUM PERFORMANCE CRITERIA. HORIZONTAL CABLING AND JACKS SHALL BE REPLACED COMPLETELY IF REUSED CABLE FAILS TO PASS TESTING CRITERIA. REUSE EXISTING TELECOM OUTLET – RELOCATE PER NEW PLANS. REFER TO NEW PLANS FOP ADDITIONAL INFORMATION.

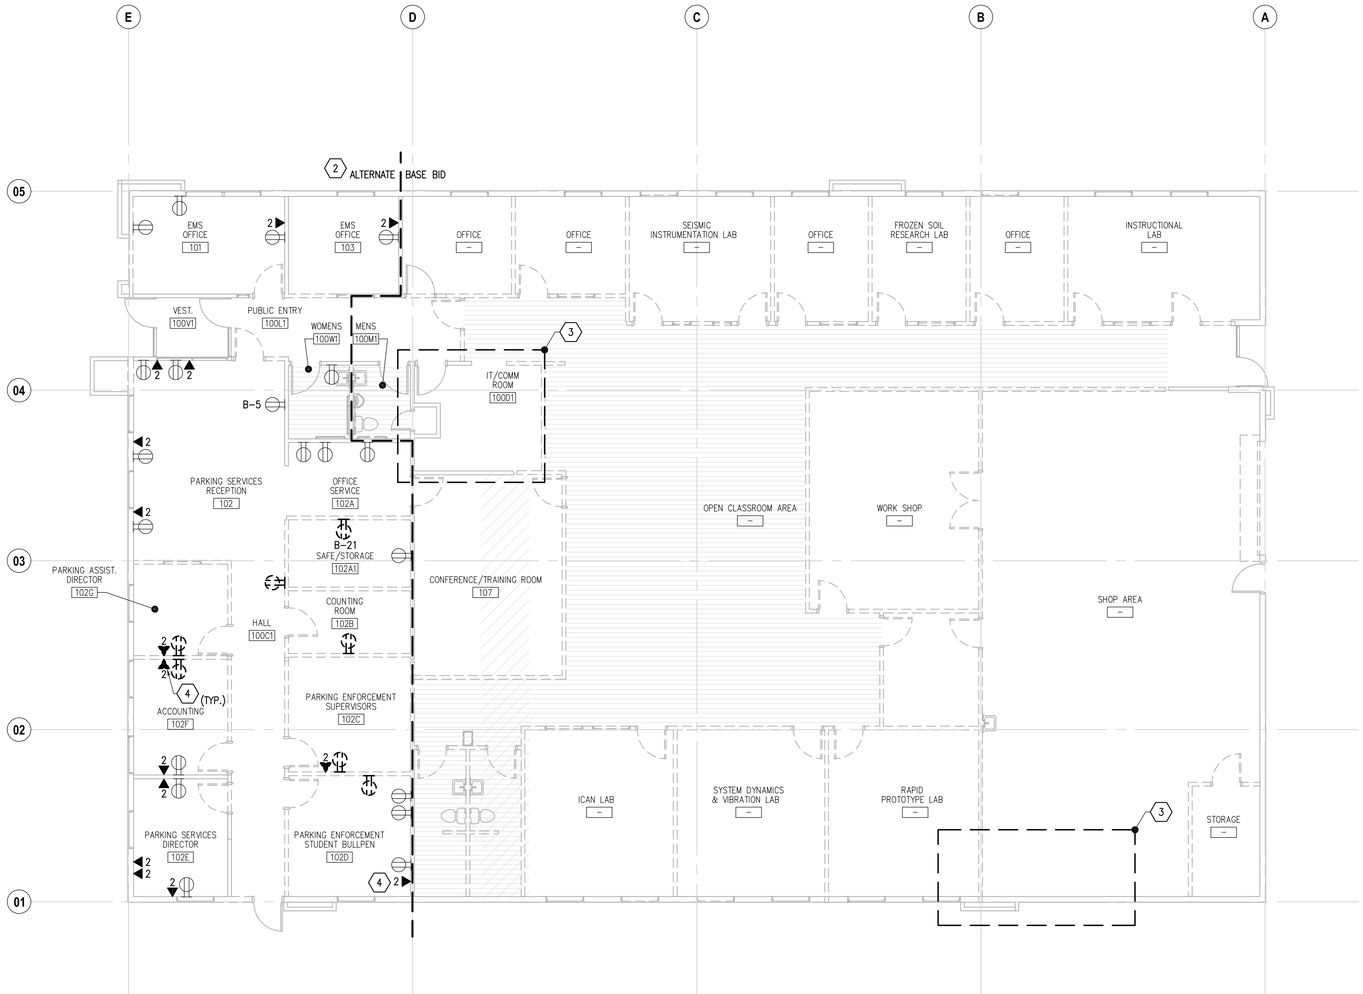

1 / E101A DEMOLITION PLAN – ELECTRICAL – ALTERNATE

SCALE: 1/8" = 1'-0"

0 4' 8' 16' 24'

RIM ARCHITECTS
ALASKA | HAWAII GUAM CALIFORNIA
645 'G' STREET, SUITE 400
ANCHORAGE, ALASKA 99501
Phone: 907.258.7777
Fax: 907.279.8195
www.rimarchitects.com

STATE OF ALASKA 49TH
Edward J. Kamienski
04/07/2017
EE-10586
REGISTERED PROFESSIONAL ENGINEER
© 17605

AMC ENGINEERS
www.amc-engineers.com
Adams, Morgenthaler & Co., Inc.
CoA No. C0342 - 907.257.9100
701 E. Tudor Rd. Suite 250
Anchorage, AK 99503

PROJECT TITLE: UAA ANSEP ULA RENOVATION
ADDRESS: UNIVERSITY LAKE BUILDING - BUILDING AO 107
OWNER: UNIVERSITY OF ALASKA ANCHORAGE
SHEET TITLE: DEMOLITION PLAN - ELECTRICAL - ALTERNATE

NO	DESCRIPTION	DATE

DATE :	2017.04.07
PROJECT NO :	17-0103
DRAWN BY :	EJK/DRM/ERP
CHECKED BY :	EJK/KAC
COPYRIGHT :	2015 RIM ARCHITECTS

DWG NO: E101A

FILE NAME: x:\17605_ANSEP\Dwgs\Edwg\Sheet Files\17605 – E101A.dwg
PLOTTED: ejk 4/7/2017 4:21 PM