SHEET NOTES

1. COORDINATE WORK WITH MECHANICAL, ARCHITECT, OWNER, AND OTHER TRADES. REFER TO AND COORDINATE WITH WORK SHOWN OTHER PLANS, DETAILS AND DIAGRAMS.
2. PROVIDE EVENLITE, RECESSED MOUNT, 125 VA, EMERGENCY MINI POWER INVERTER, MODEL PW-12-LC-V1 OR APPROVED EQUAL, AT LOCATION INDICATED. LOCATE RECESSED INTO VESTIBULE CEILING. CONNECT INVERTER TO TYPE SB1 FIXTURES FOR EMERGENCY LIGHTING ON EXTERIOR BUILDING.
3. PROVIDE 4-POLE LIGHTING CONTACTOR WITH HAND/OFF/AUTO CONTROL AND PHOTOCELL FOR CONTROL OF EXTERIOR LIGHTING FIXTURES. CONNECT EXTERIOR LIGHT FIXTURES PROVIDED UNDER BASE BID OR ALTERNATE THROUGH CONTACTOR. OF LOCATE CONTACTOR IN ELECTRICAL ROOM.
4. PROVIDE ACUITY nLIGHT LIGHTING CONTROLS SYSTEM FOR THIS AREA. INCLUDE FIVE LIGHTING ZONES FOR SETTING SCENES FOR A/V AND PRESENTATIONS. INTEGRATE WITH THE EXTRON A/V CONTROL SYSTEM PROVIDED BY THE A/V CONTRACTOR. THE A/V SYSTEM CONTROLS WILL BE LOCATED IN A CREDENZA NEAR OFFICE 5. PROVIDE LIGHTING ZONES AS PER PLANS AND AS FOLLOWS: ZONE 1 = "a", ZONE 2 = "b", ZONE 3 = "c", ZONE 4 = "d", ZONE 5 = "e" ALL OTHER AREAS NOT INCLUDED IN ZONES 1-4. COORDINATE EXACT LIGHTING CONTROLS REQUIREMENTS AND WORK WITH OWNER AND A/V CONTRACTOR.
5. PROVIDE nLIGHT nPOD GFX WALL POD CONTROLLER IN THIS LOCATION. FOR LOCAL CONTROL OF LIGHTING CONTROL ZONES.
6. EXISTING LIGHTING FIXTURES, EMERGENCY LIGHT UNITS, EXIT SIGNS AND EXTERIOR LIGHTING IN ALTERNATE AREA SHALL REMAIN AND BE REUSED UNDER BASE BID WORK. RE-CIRCUIT TO NEW PANEL B – CIRCUIT AS INDICATED. REFER TO SHEET NOTE 8 FOR EXISTING 2'X4' FLUORESCENT LIGHT FIXTURES CLARIFICATIONS.
7. RELOCATE EXISTING LIGHT SWITCH TO LOCATION INDICATED. INTERCEPT, EXTEND, AND RE-CONNECT EXISTING SWITCHED AND UNSWITCHED LIGHTING CONDUCTORS AS REQUIRED.
8. EXISTING 2'X4' FLUORESCENT LIGHT FIXTURES: REMOVE, CLEAN AND PREP FOR RE-INSTALLATION. REINSTALL IN LOCATIONS SHOWN, RE-CIRCUIT AS INDICATED.

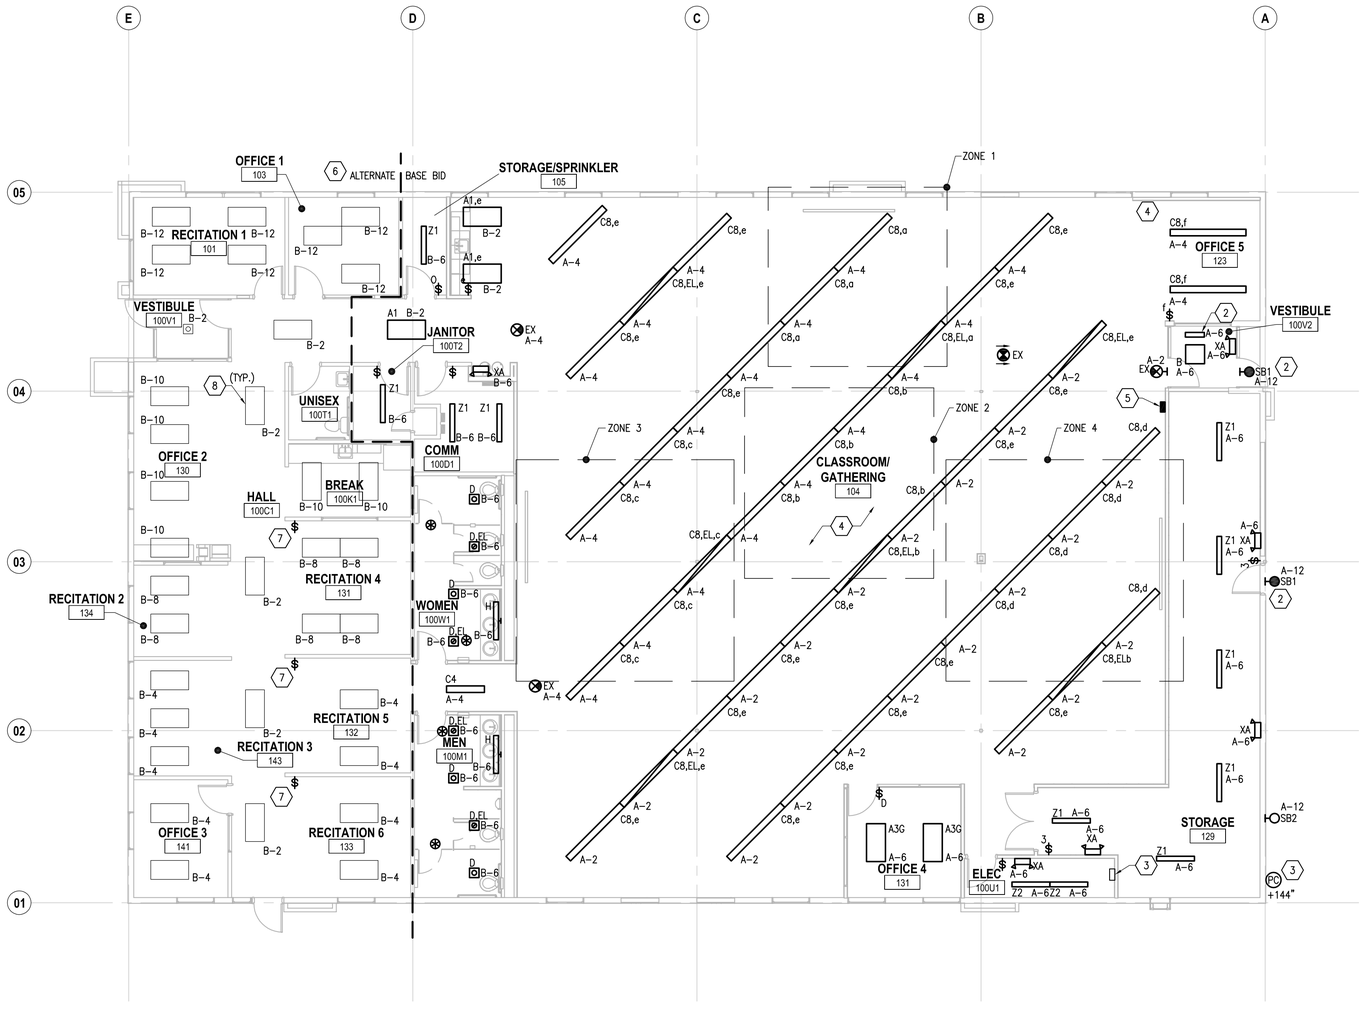

1 / E201 FLOOR PLAN – LIGHTING – BASE BID

SCALE: 1/8" = 1'-0"

0 4' 8' 16' 24'

RIM ARCHITECTS
ALASKA | HAWAII GUAM CALIFORNIA
645 'G' STREET, SUITE 400
ANCHORAGE, ALASKA 99501
Phone: 907.258.7777
Fax: 907.279.8195
www.rimarchitects.com

STATE OF ALASKA 49TH
Edward J. Kamienski
04/07/2017
EE-10586
REGISTERED PROFESSIONAL ENGINEER
© 17605

AMC ENGINEERS
www.amc-engineers.com
Adams, Morgenthaler & Co., Inc.
CoA No. C0342 - 907.257.9100
701 E. Tudor Rd. Suite 250
Anchorage, AK 99503

PROJECT TITLE: UAA ANSEP ULA RENOVATION
ADDRESS: UNIVERSITY LAKE BUILDING - BUILDING AO 107
OWNER: UNIVERSITY OF ALASKA ANCHORAGE
SHEET TITLE: FLOOR PLAN - LIGHTING - BASE BID

NO	DESCRIPTION	DATE

DATE : 2017.04.07
PROJECT NO : 17-0103
DRAWN BY : EJK/DRM/ERP
CHECKED BY : EJK/KAC
COPYRIGHT : 2015 RIM ARCHITECTS

DWG NO: E201

FILE NAME: X:\17605 ANSEP\Dwgs\Edwg\Sheet Files\17605 - E201.dwg
PLOTTED: ejk 4/7/2017 4:21 PM