SHEET NOTES

1. COORDINATE WORK WITH MECHANICAL, ARCHITECT, OWNER AND OTHER TRADES. REFER TO AND COORDINATE WORK WITH WORK SHOWN ON NEW PLANS, DETAILS AND DIAGRAMS.

(2) EXISTING ROOF MOUNTED VENTILATION UNITS SHALL REMAIN. USE CARE AND IDENTIFY/TAG EXISTING BRANCH CIRCUITS FOR REUSE WHEN DEMOLISHING EXISTING PANELS. LOCATE, EXTEND, AND RE-CONNECT EXISTING BRANCH CIRCUITS AS NECESSARY TO NEW OR RECONFIGURED PANELS. REFER TO THE NEW PANEL SCHEDULES FOR ADDITIONAL INFORMATION. REFER TO MECHANICAL ROOF PLANS FOR ADDITIONAL INFORMATION. VERIFY EXISTING OVERLOAD PROTECTION IS SUFFICIENT FOR THE #8 AWG CONDUCTOR.

(3) PROVIDE WP, GFCI, DUPLEX RECEPTACLE. MOUNT TO SCREENING STRUCTURE AT HEIGHT NOTED. CONNECT TO CIRCUIT NOTED.

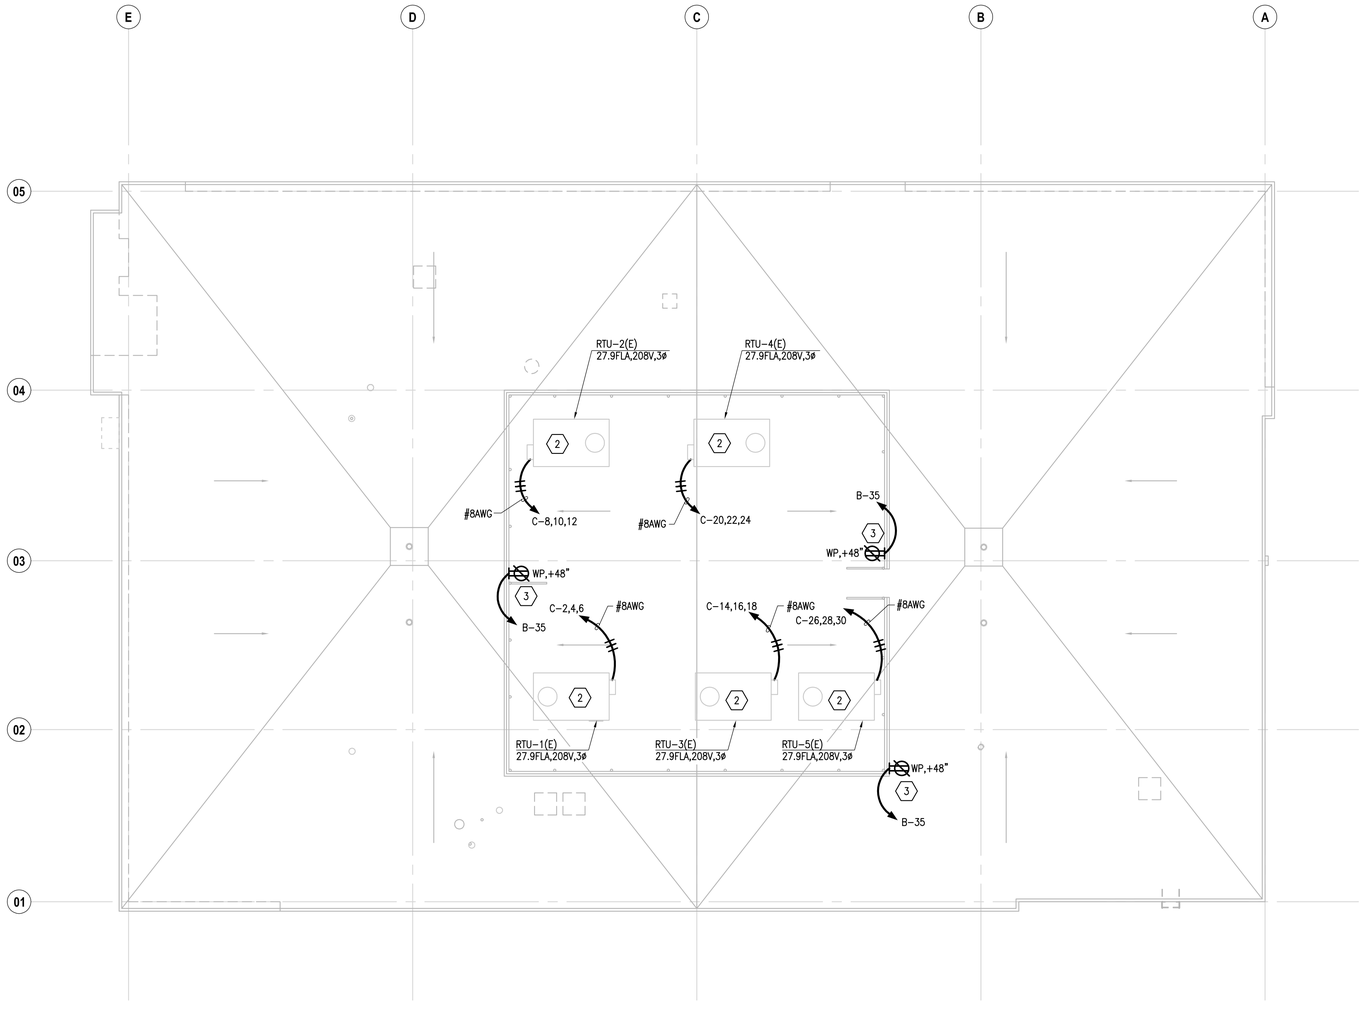

1 / E301 ROOF PLAN – ELECTRICAL – DEMOLITION AND NEW

SCALE: 1/8" = 1'-0"

0 4' 8' 16' 24'

RIM ARCHITECTS

ALASKA | HAWAII GUAM CALIFORNIA

645 'G' STREET, SUITE 400
ANCHORAGE, ALASKA 99501
Phone: 907.258.7777
Fax: 907.279.8195
www.rimarchitects.com

STATE OF ALASKA 49TH
Edward J. Kamienski
04/07/2017
EE-10586
REGISTERED PROFESSIONAL ENGINEER
© 17605

AMC ENGINEERS
www.amc-engineers.com
Adams, Morgenthaler & Co., Inc.
CoA No. C0342 - 907.257.9100
701 E. Tudor Rd. Suite 250
Anchorage, AK 99503

PROJECT TITLE: UAA ANSEP ULA RENOVATION
ADDRESS: UNIVERSITY LAKE BUILDING - BUILDING AO 107
OWNER: UNIVERSITY OF ALASKA ANCHORAGE
SHEET TITLE: ROOF PLAN - ELECTRICAL

NO	DESCRIPTION	DATE

DATE : 2017.04.07
PROJECT NO : 17-0103
DRAWN BY : EJK/DRM/ERP
CHECKED BY : EJK/KAC
COPYRIGHT : 2015 RIM ARCHITECTS

DWG NO: E301

FILE NAME: X:\17605 ANSEP\Dwgs\Edwg\Sheet Files\17605 - E301.dwg
PLOTTED: ejk 4/7/2017 4:22 PM