

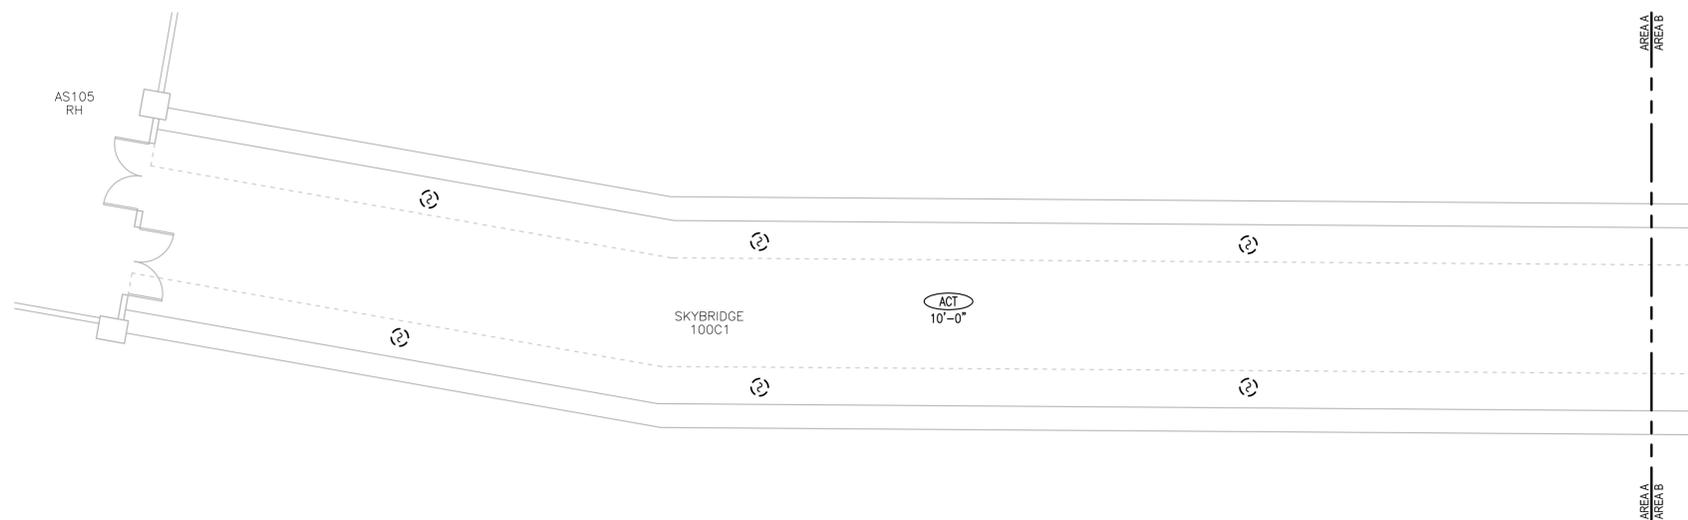


SHEET NOTES



- UNLESS OTHERWISE NOTED DEMOLISH ALL EXISTING FIRE ALARM DEVICES, APPLIANCES AND PANELS UNDER THE FIRE ALARM INSTALLATION WORK. EXISTING FIRE ALARM SYSTEM EQUIPMENT, DEVICE AND APPLIANCE QUANTITIES AND LOCATIONS SHOWN ARE BASED UPON AS-BUILT DRAWINGS AND LIMITED FIELD VERIFICATION. COORDINATE/PHASE DEMOLITION AND NEW WORK TO ENSURE THERE IS NO LAPSE OF FIRE ALARM SYSTEM COVERAGE. REFER TO SECTIONS 26 0000 ELECTRICAL GENERAL REQUIREMENTS AND 28 3100 ADDRESSABLE FIRE ALARM FOR SPECIFIC DEMOLITION AND FIRE ALARM SYSTEM REQUIREMENTS.
- EXISTING MAGNETIC DOOR HOLDERS AND DOOR CLOSERS SHALL REMAIN AND SHALL BE CONNECTED TO AND CONTROLLED BY THE NEW FIRE ALARM SYSTEM.
- EXISTING FAA, DETECTOR NAC APPLIANCE ARE CONNECTED TO THE WFSC FIRE ALARM SYSTEM AND SHALL REMAIN.

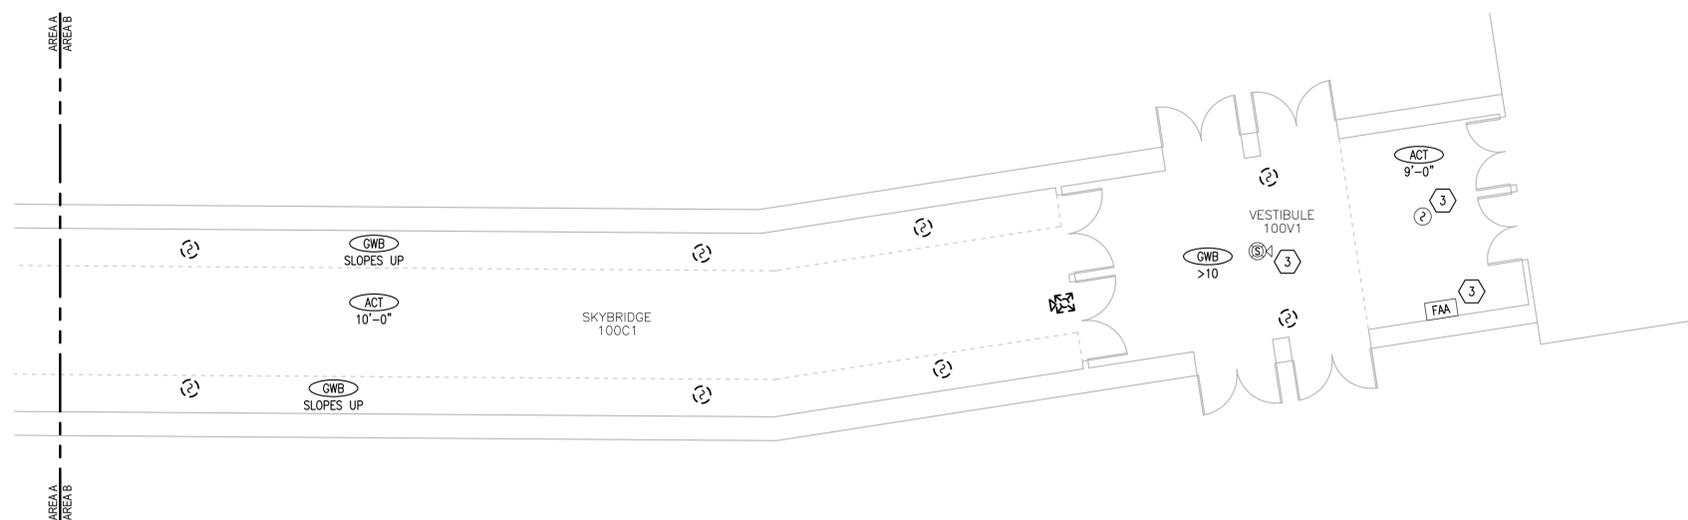

1 SKYBRIDGE - FIRE ALARM - DEMOLITION - AREA A
E109 SCALE: 1/8" = 1'-0"



2 SKYBRIDGE - FIRE ALARM - DEMOLITION - AREA B
E109 SCALE: 1/8" = 1'-0"

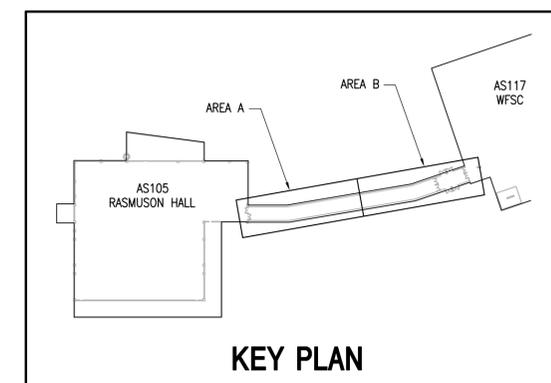

UNIVERSITY OF ALASKA ANCHORAGE
RASMUSON HALL FIRE ALARM REPLACEMENT
PROJECT NUMBER 17-0071

Revisions		
No.	Date	Description

Design: EJK/NPS/KTR

Drawn: ERP

Date: 04/26/2017

Sheet Title
SKYBRIDGE - FIRE ALARM - DEMOLITION

Sheet Number

E109