

BASIC BID - FT. RICHARDSON



RSA


CAMP DENALI - DELITE SYSTEM

REVISIONS

DRAWN &
CHECKED
DATE:
JOB NO.
DWG FILE

DRAWING
ELECTR.
LIGHTING
PLANS



SHEET:
E

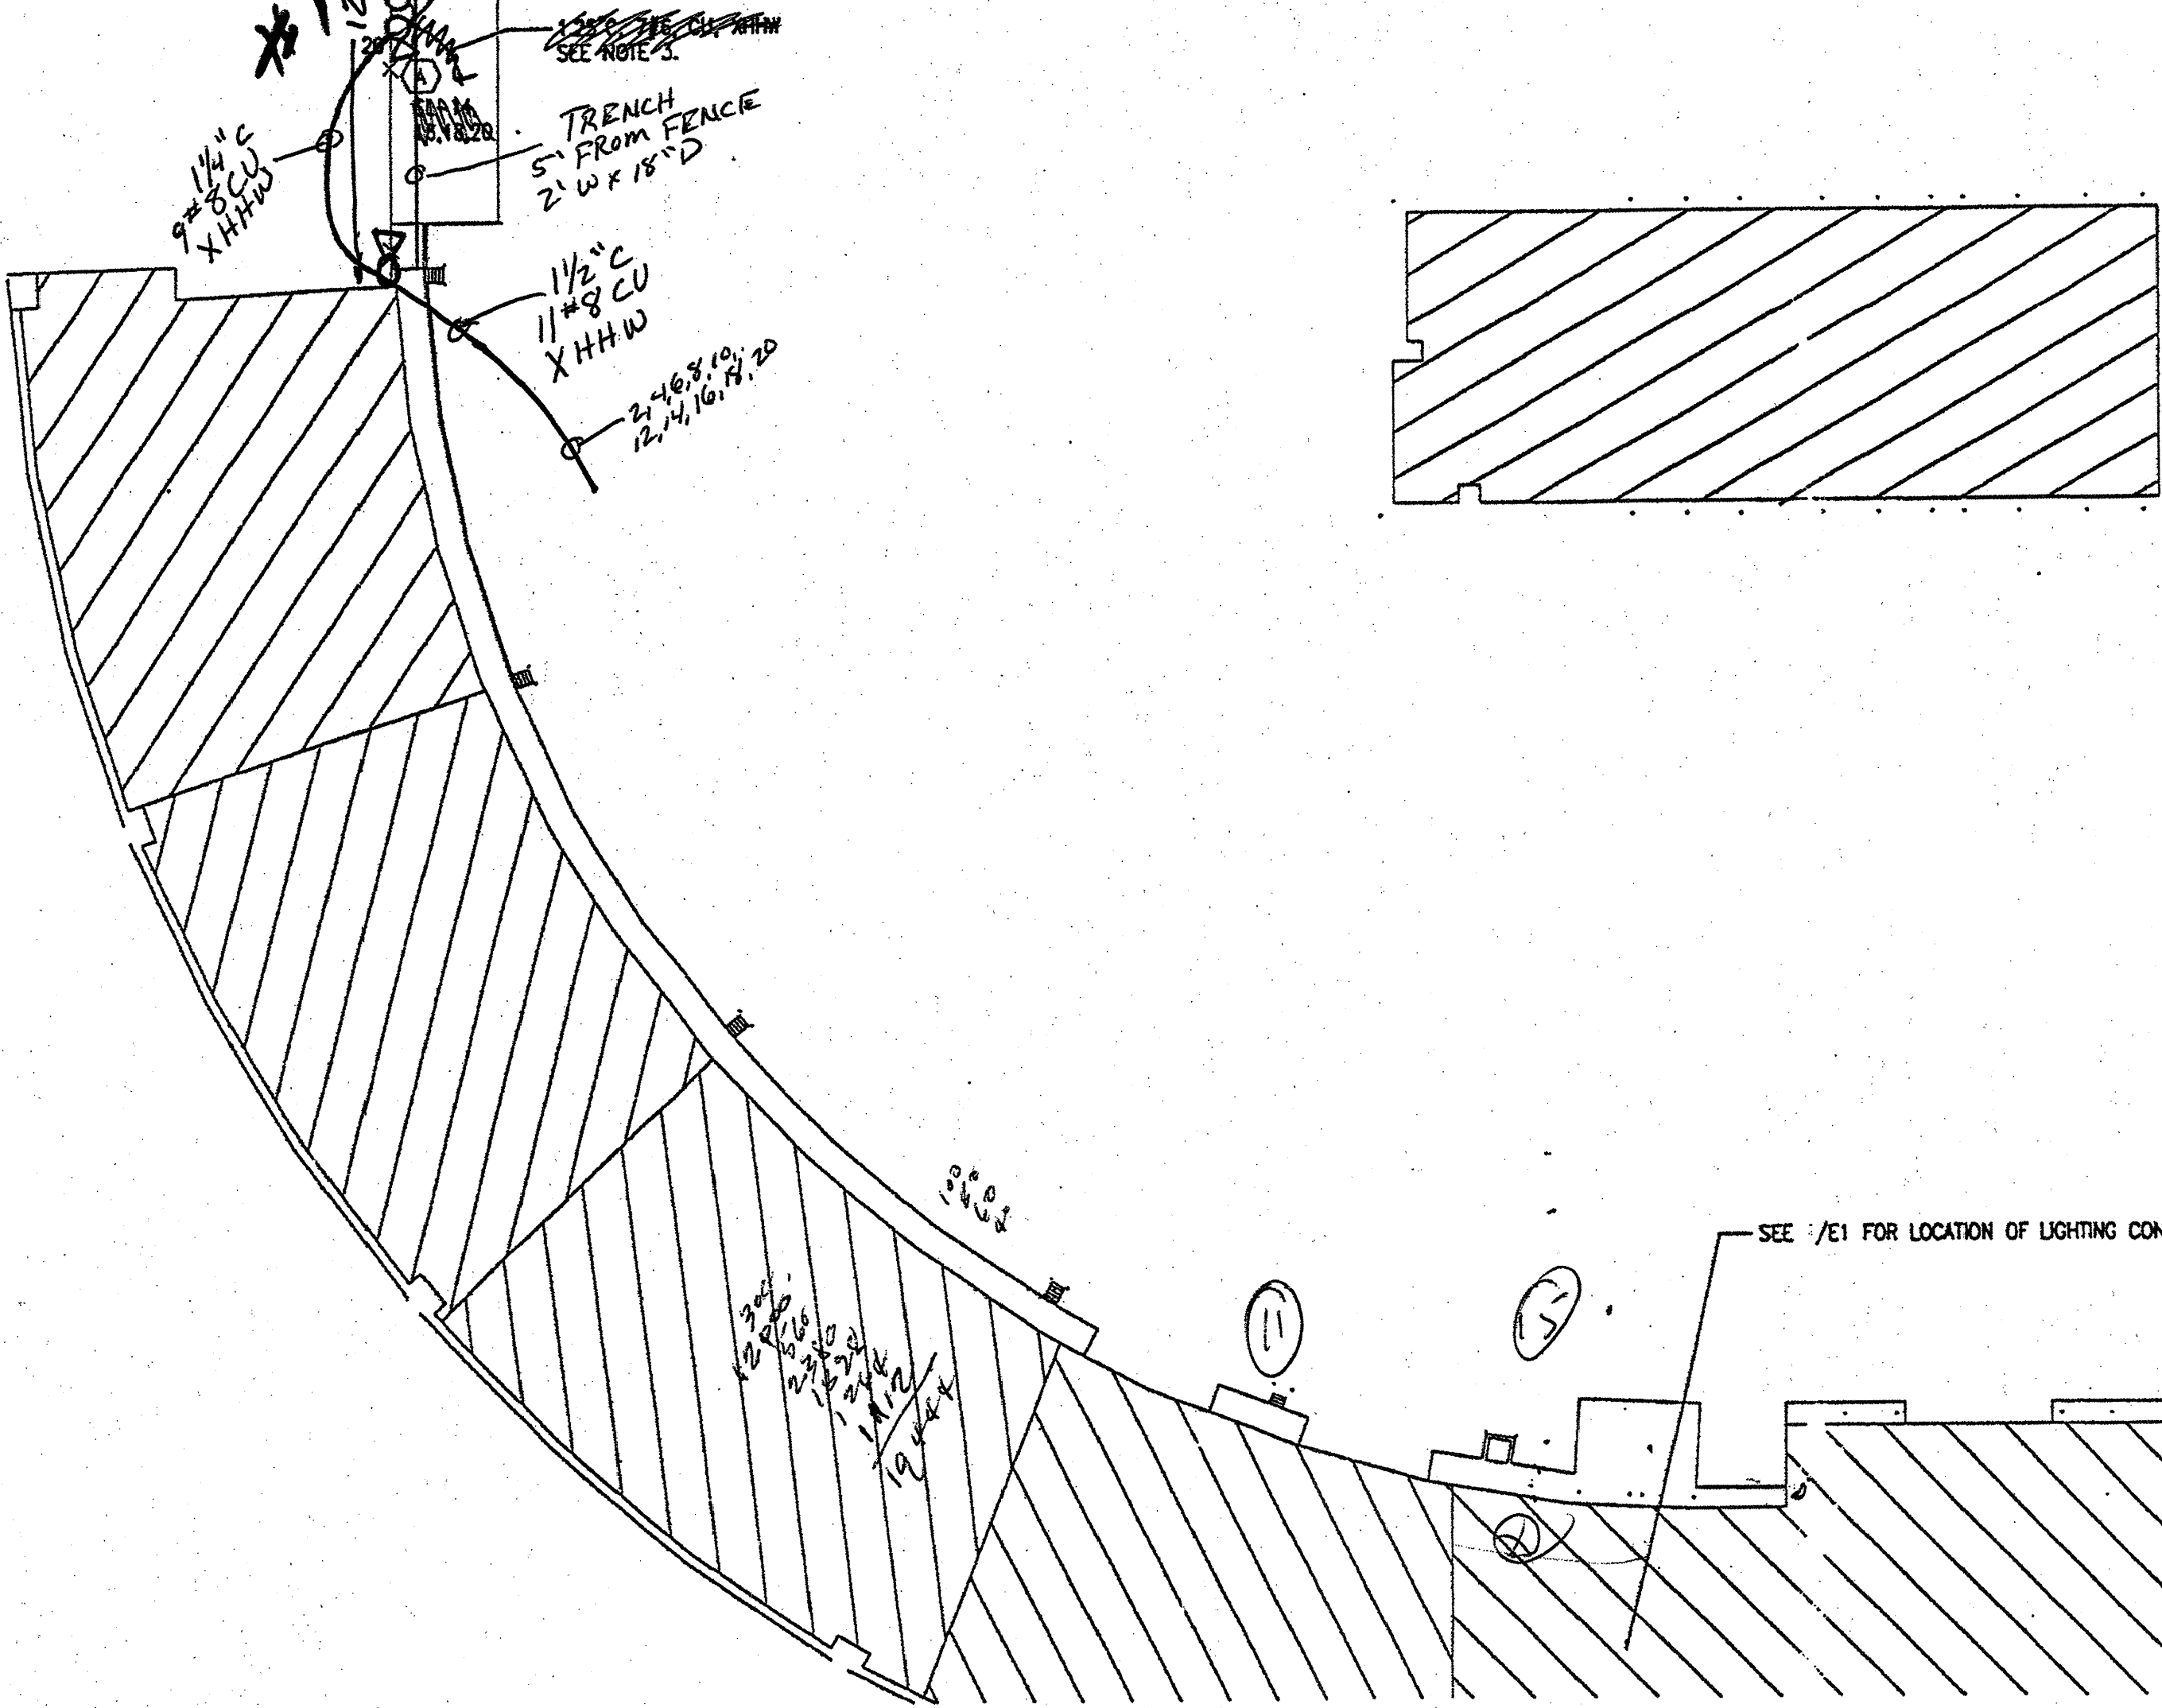

1 ELECTRICAL LIGHTING PLAN

NOTES:

- 25' CLASS 5, ANSI D5.1 DOUGLAS FIR POLE TREATED WITH A PRESERVATIVE, COMPLYING WITH ASTM D390 APPLIED IN ACCORDANCE WITH AWPAC 04 WITH A MINIMUM NET RETENTION OF 12 LBS./CU.FT. FOR LOCATIONS WHERE ONLY MOTION SENSORS ARE INSTALLED USE 20' CLASS 5 POLES, SEE 1/E3.
- SEE 2/E1 FOR AMING DETAILS. SEE 3/E2 FOR MOUNTING DETAILS.
- INSTALL #12AWG PIGTAILS ON CONDUCTORS IN PANELBOARD GUTTER FOR CONNECTION TO CIRCUIT BREAKER.

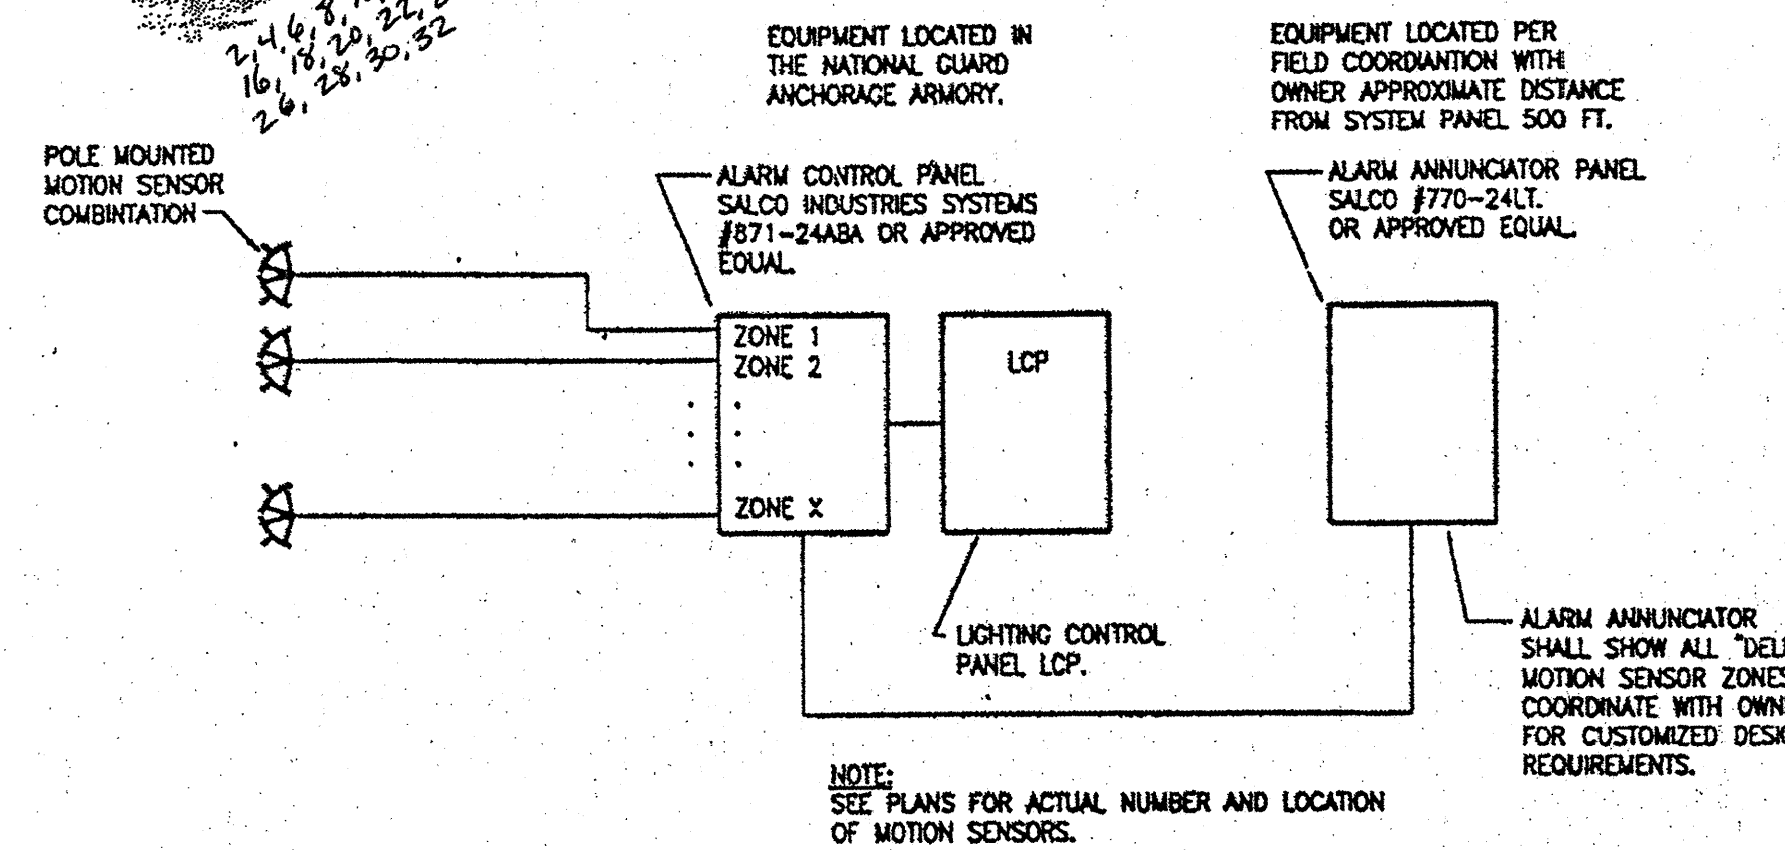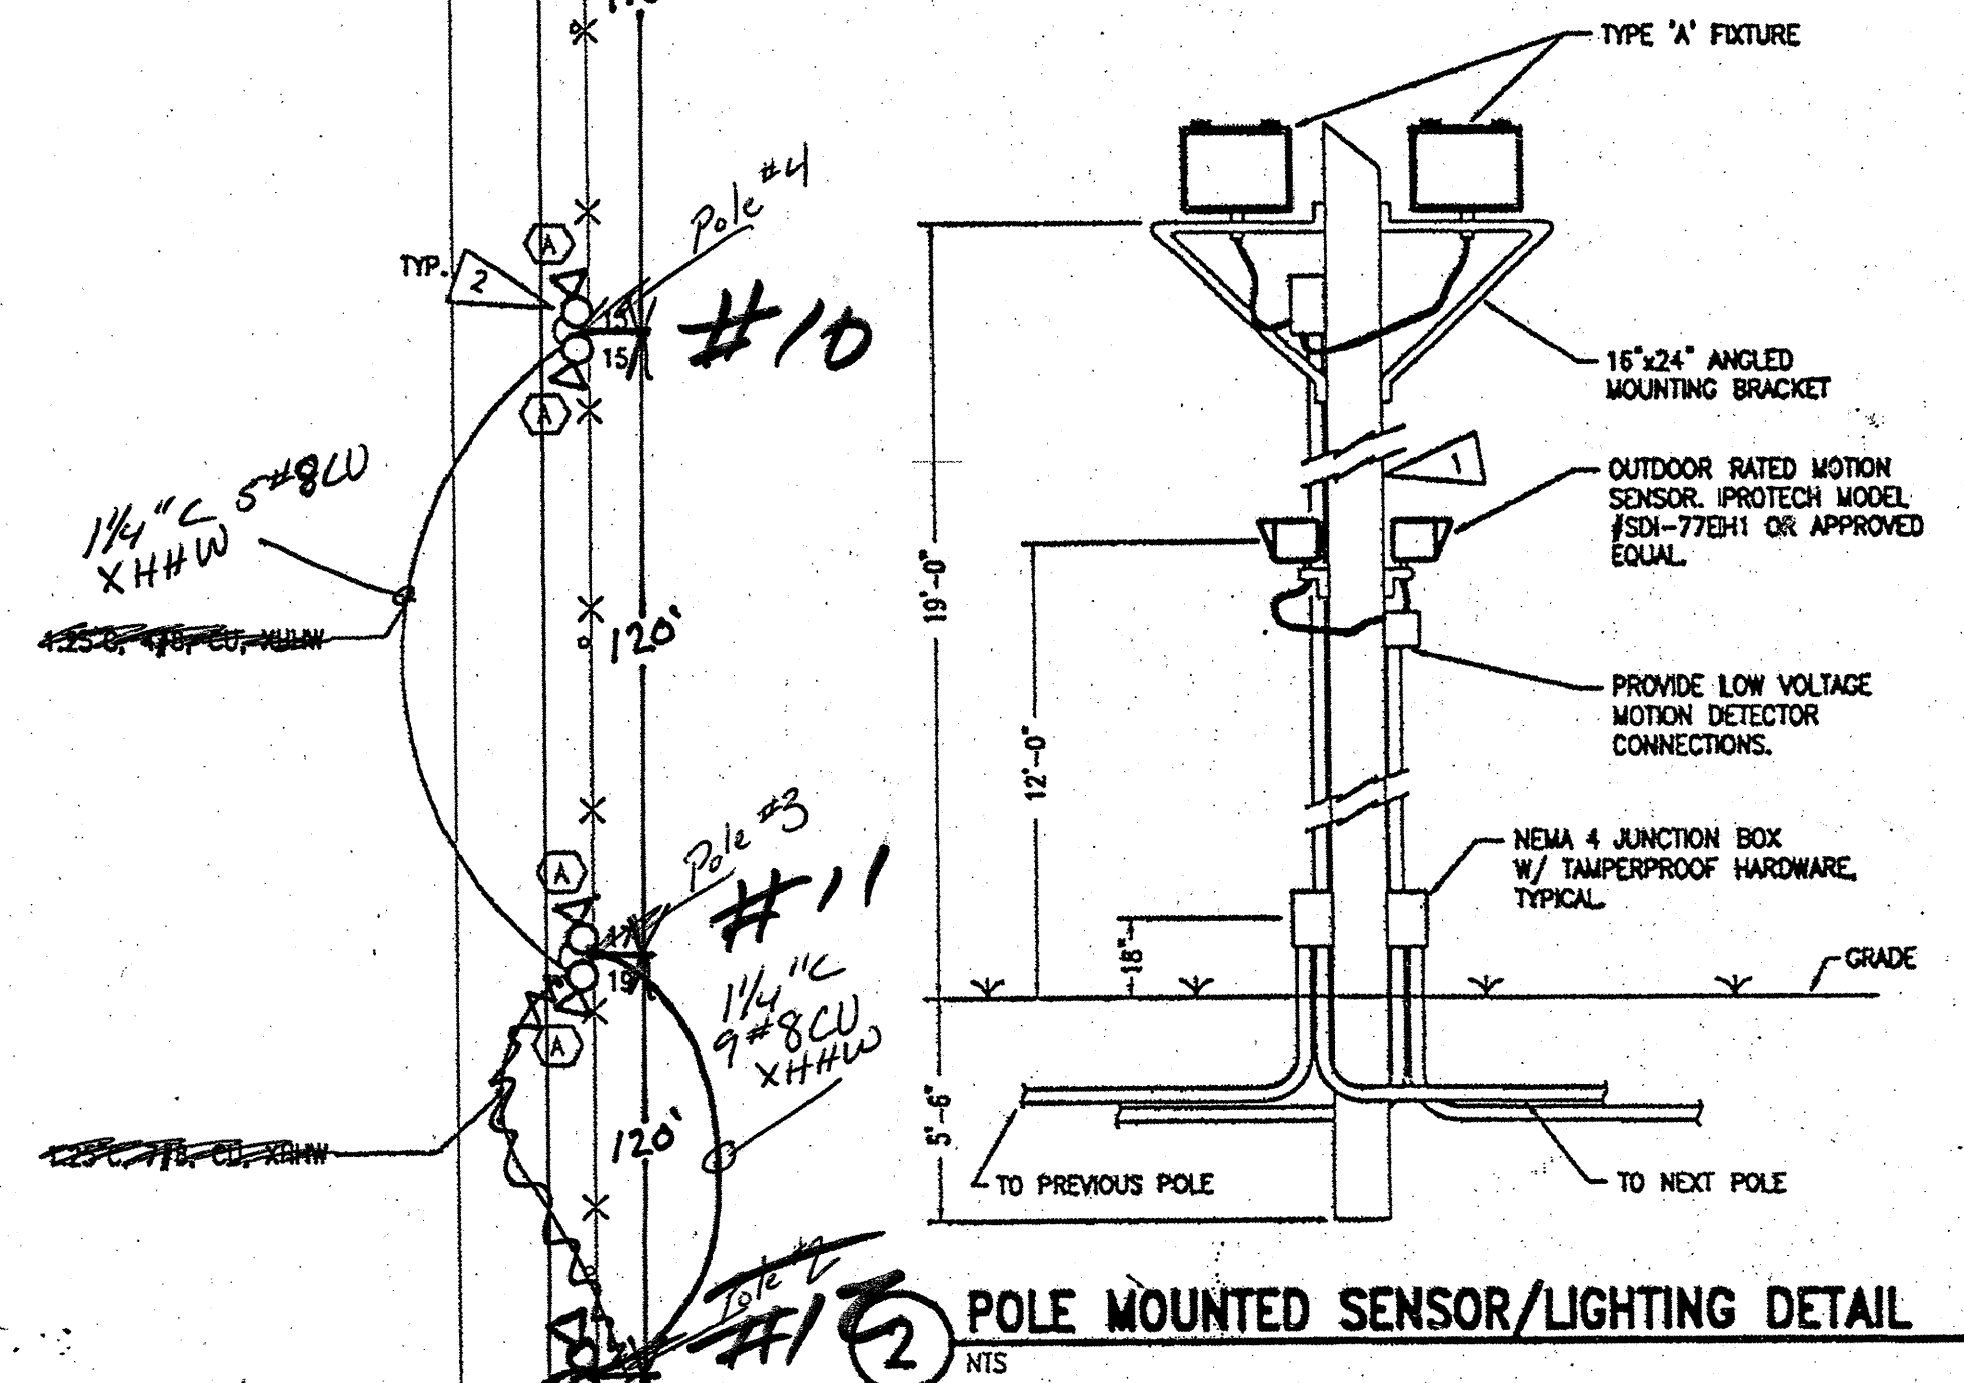

3 SECURITY LIGHTING DETAIL