


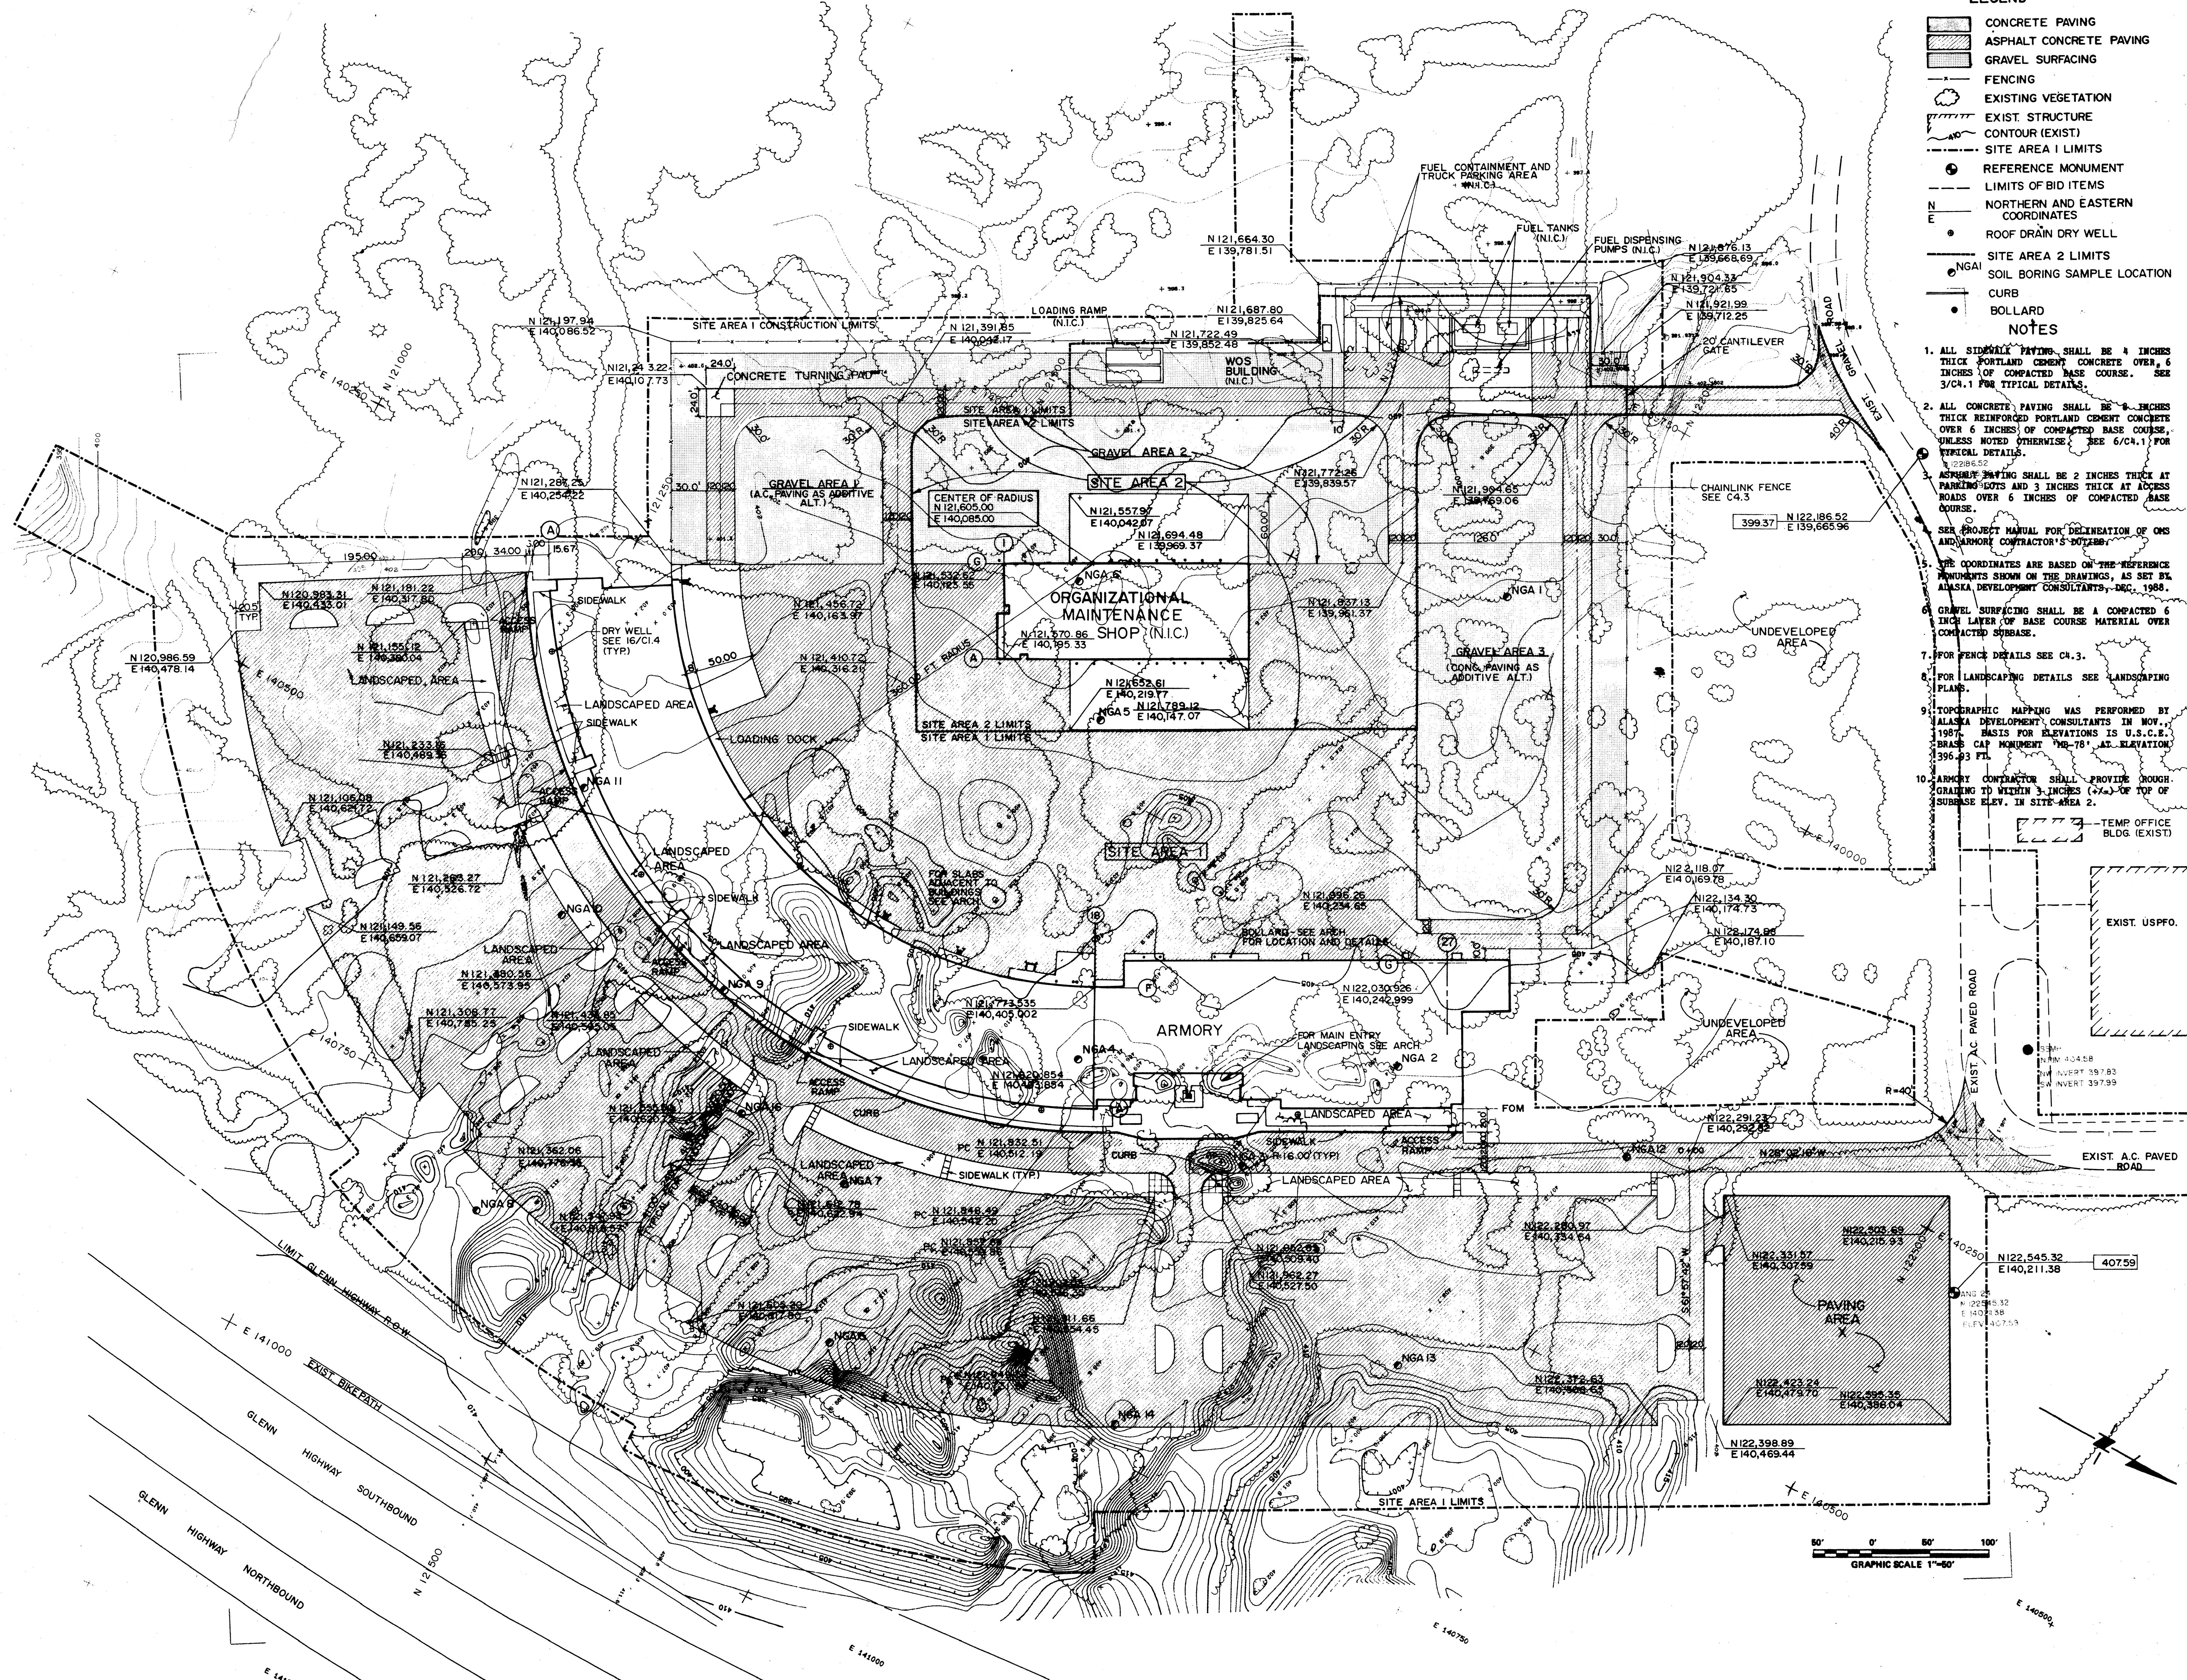

LEGEND


- CONCRETE PAVING
- ASPHALT CONCRETE PAVING
- GRAVEL SURFACING
- FENCING
- EXISTING VEGETATION
- EXIST. STRUCTURE
- CONTOUR (EXIST)
- SITE AREA 1 LIMITS
- REFERENCE MONUMENT
- LIMITS OF BID ITEMS
- NORTHERN AND EASTERN COORDINATES
- ROOF DRAIN DRY WELL
- SITE AREA 2 LIMITS
- SOIL BORING SAMPLE LOCATION
- CURB
- BOLLARD

NOTES

1. ALL SIDEWALK PAVING SHALL BE 4 INCHES THICK PORTLAND CEMENT CONCRETE OVER 6 INCHES OF COMPACTED BASE COURSE. SEE 3/C4.1 FOR TYPICAL DETAILS.
2. ALL CONCRETE PAVING SHALL BE 8 INCHES THICK REINFORCED PORTLAND CEMENT CONCRETE OVER 6 INCHES OF COMPACTED BASE COURSE, UNLESS NOTED OTHERWISE. SEE 6/C4.1 FOR TYPICAL DETAILS.
3. ASPHALT PAVING SHALL BE 2 INCHES THICK AT PARKING LOTS AND 3 INCHES THICK AT ACCESS ROADS OVER 6 INCHES OF COMPACTED BASE COURSE.
4. SEE PROJECT MANUAL FOR DELINEATION OF ONE AND A HALF CONTRACTOR'S DETAIL.
5. THE COORDINATES ARE BASED ON THE REFERENCE MONUMENTS SHOWN ON THE DRAWINGS, AS SET BY ALASKA DEVELOPMENT CONSULTANTS, DEC. 1988.
6. GRAVEL SURFACING SHALL BE A COMPACTED 6 INCH LAYER OF BASE COURSE MATERIAL OVER COMPACTED SUBBASE.
7. FOR FENCE DETAILS SEE C4.3.
8. FOR LANDSCAPING DETAILS SEE LANDSCAPING PLANS.
9. TOPOGRAPHIC MAPPING WAS PERFORMED BY ALASKA DEVELOPMENT CONSULTANTS IN NOV. 1987. BASIS FOR ELEVATIONS IS U.S.C.E. BRASS CAP MONUMENT "M-78" AT ELEVATION 396.93 FT.
10. ARMORY CONTRACTOR SHALL PROVIDE ROUGH GRADING TO WITHIN 3 INCHES (3/4") OF TOP OF SUBBASE ELEV. IN SITE AREA 2.

charles
bettsworth
and
company

architecture · planning
p.o. box 73209, fairbanks, alaska
3900 arctic blvd., anchorage, alaska

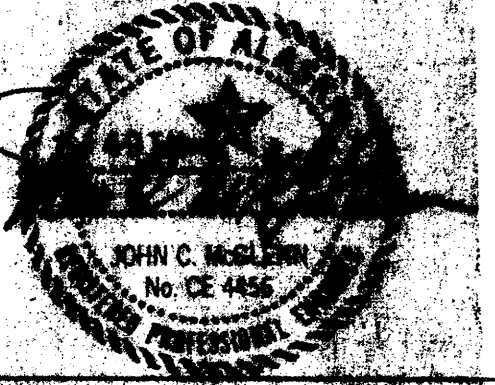

consultants:

KCM

Kramer, Chin & Mayo, Inc.
3701 East Tudor Road
Anchorage, Alaska 99507-1217
(907) 563-0886

Alaska Army National Guard
Anchorage Armory
Project No. DAHA51-87-C-0033

Camp Denali
Fort Richardson, Alaska

job no. 1329-01
drawn by CMG/BLS
date 6/30/89

SITE PLAN

IFB No. DACA85-89-B-0026

C 1.1