

16' 1"

OPEN AREA

ROOM 2177

DNA MISC. STORAGE

MAX HIEGHT 8'
SHELF DIM. 18'H X 18"D

7 1/4"

3"

7 1/4"



20' 2"

19' 11"

29' 10"

2' 4"


2' 4"




CODIS EXTRACTION
LAB SHELL
2227

STORAGE
2233

BLOOD SAMPLE
STORAGE
2228

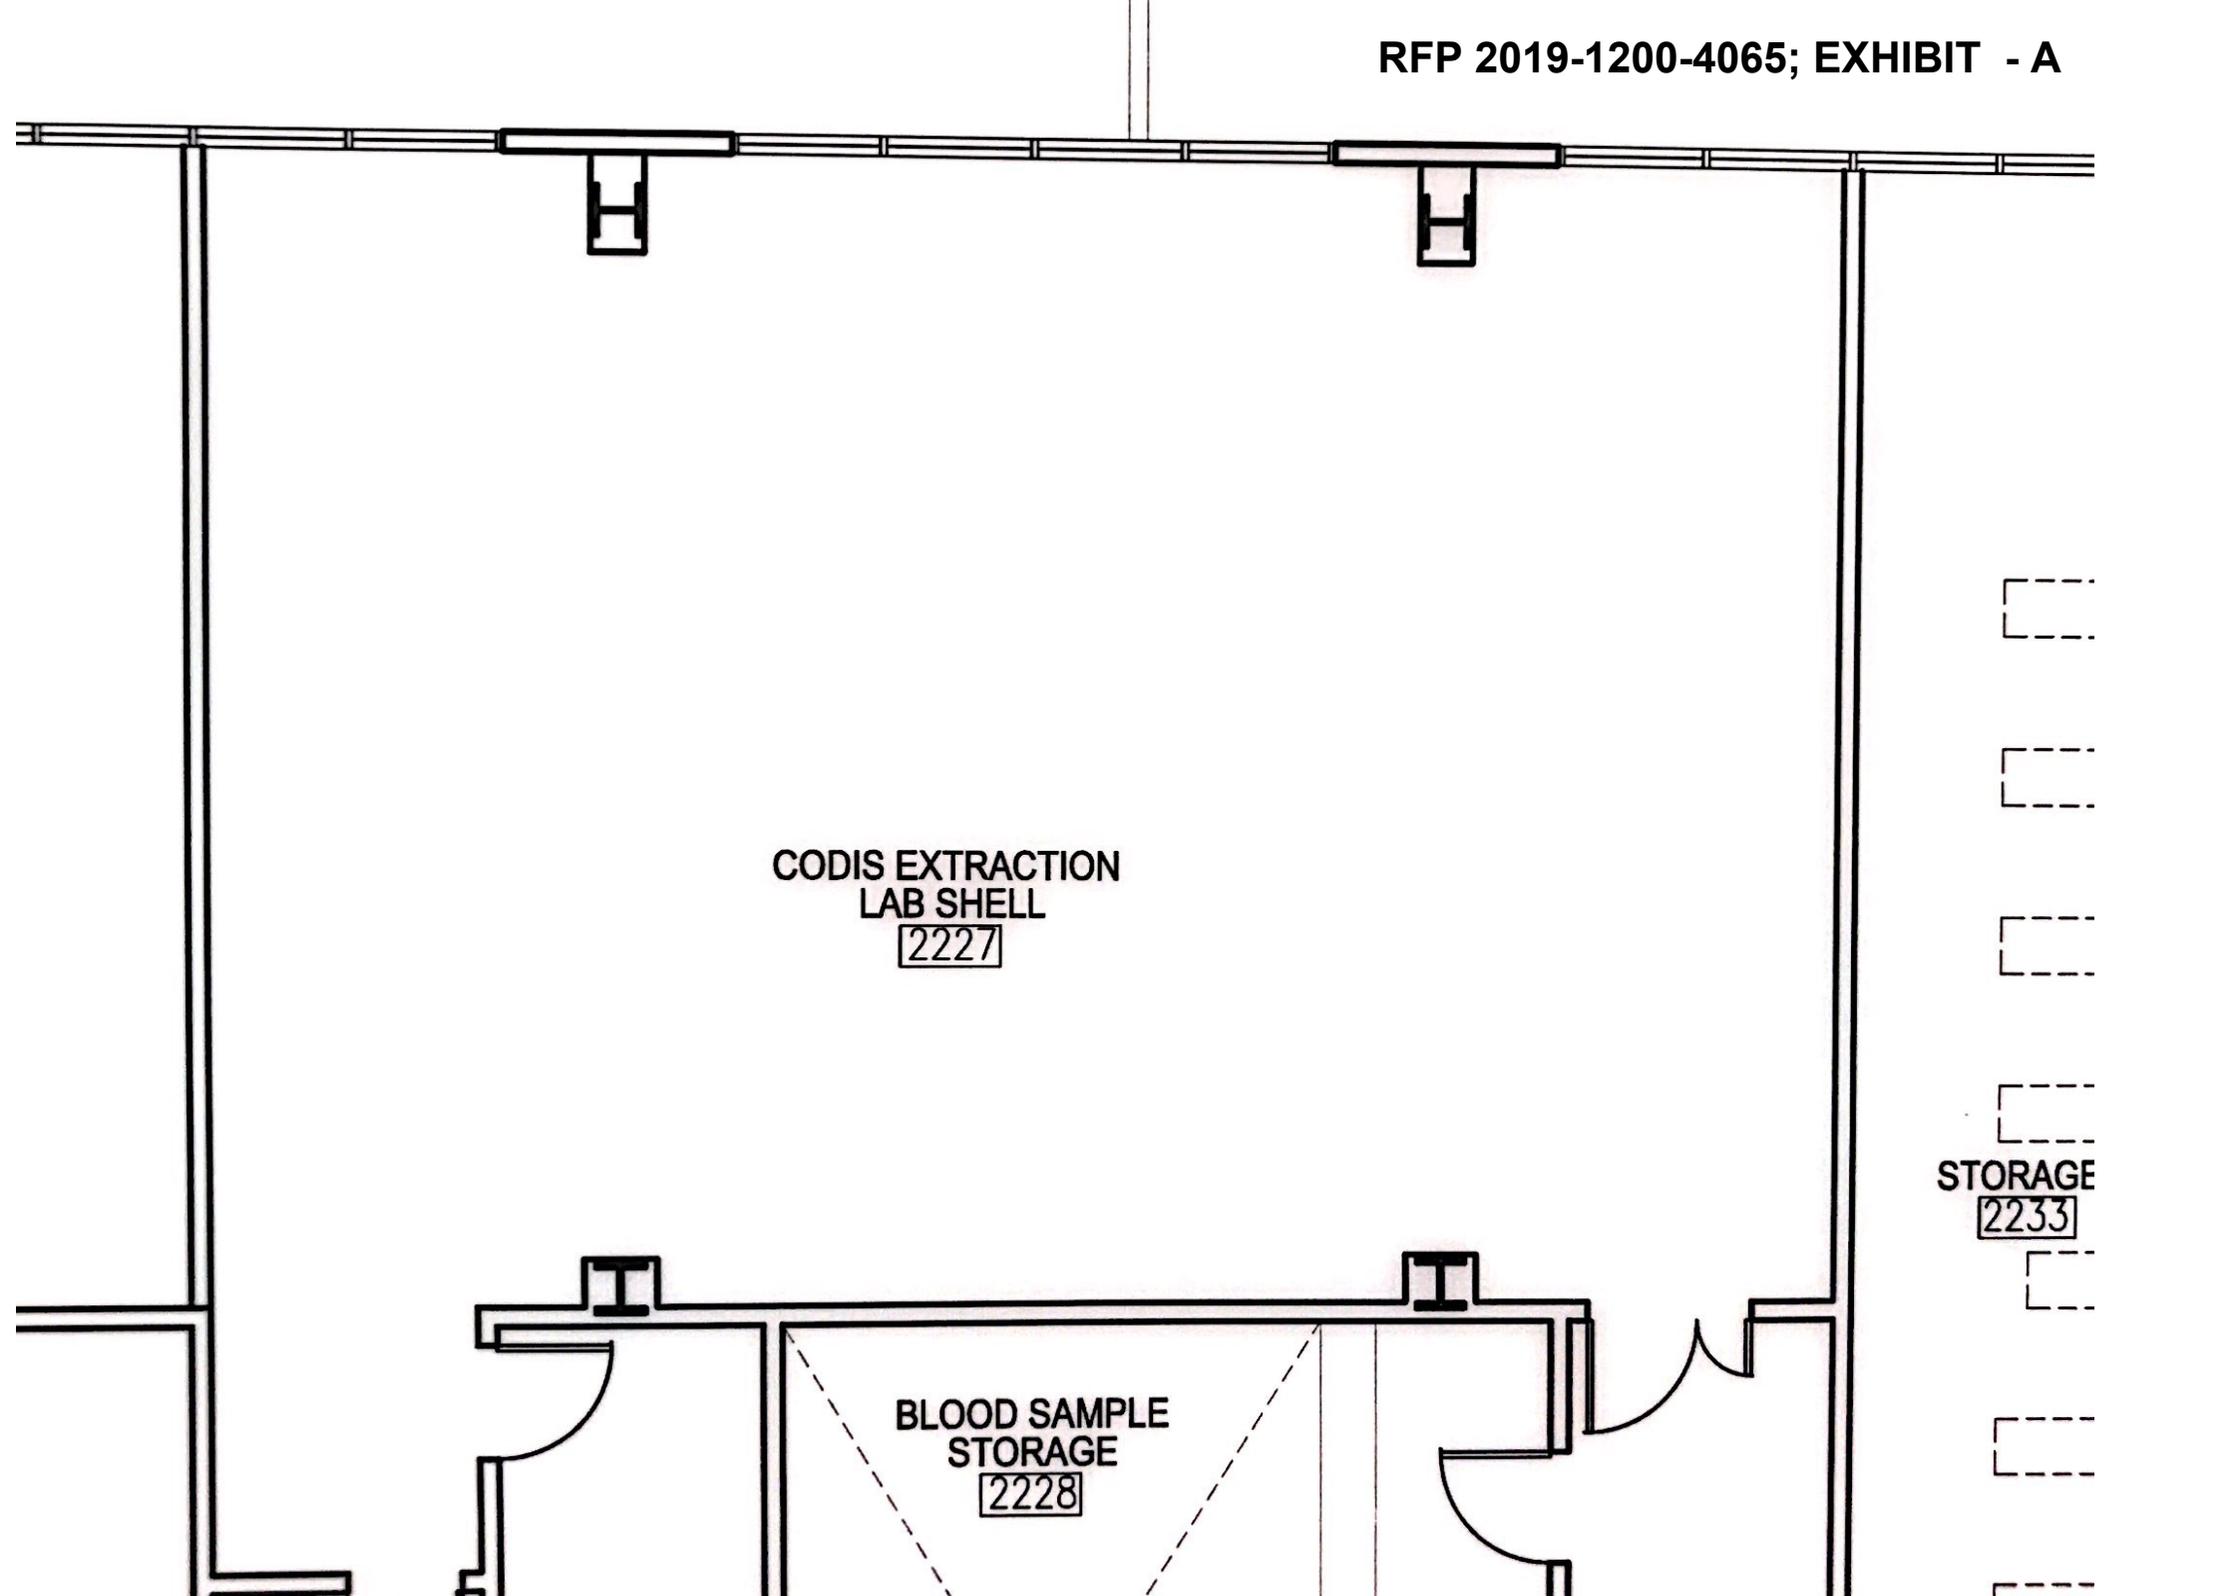

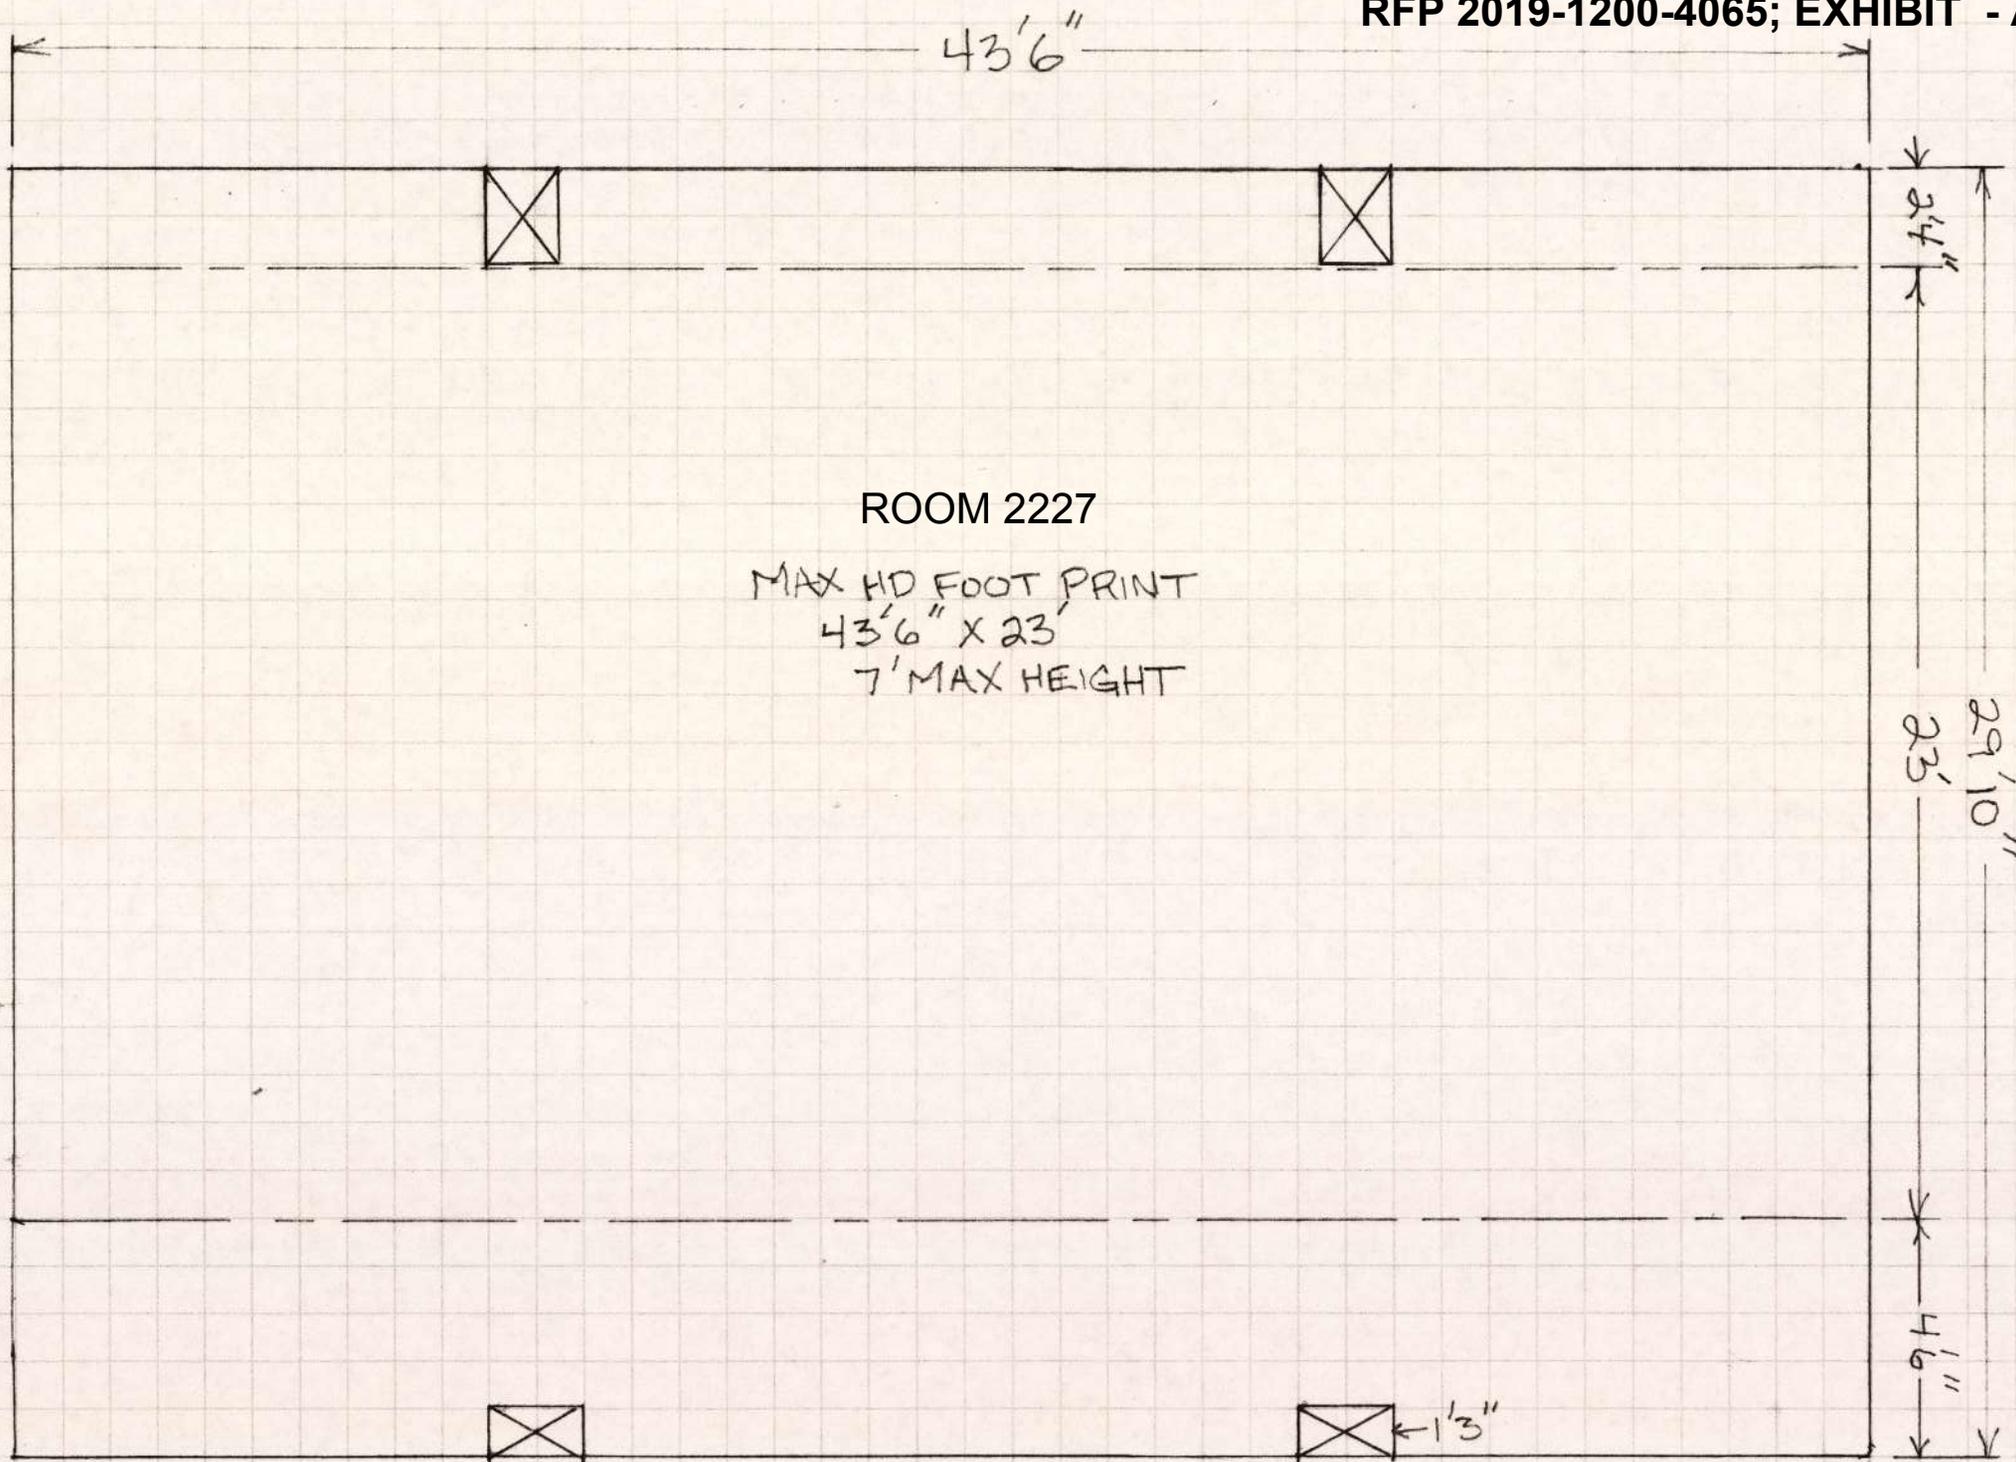

43'6"

ROOM 2227

MAX HD FOOT PRINT
43'6" X 23'
7' MAX HEIGHT

3'4"


23'
29'10"

4'6"

1'3"

ROOM 1277

ROOM 1278

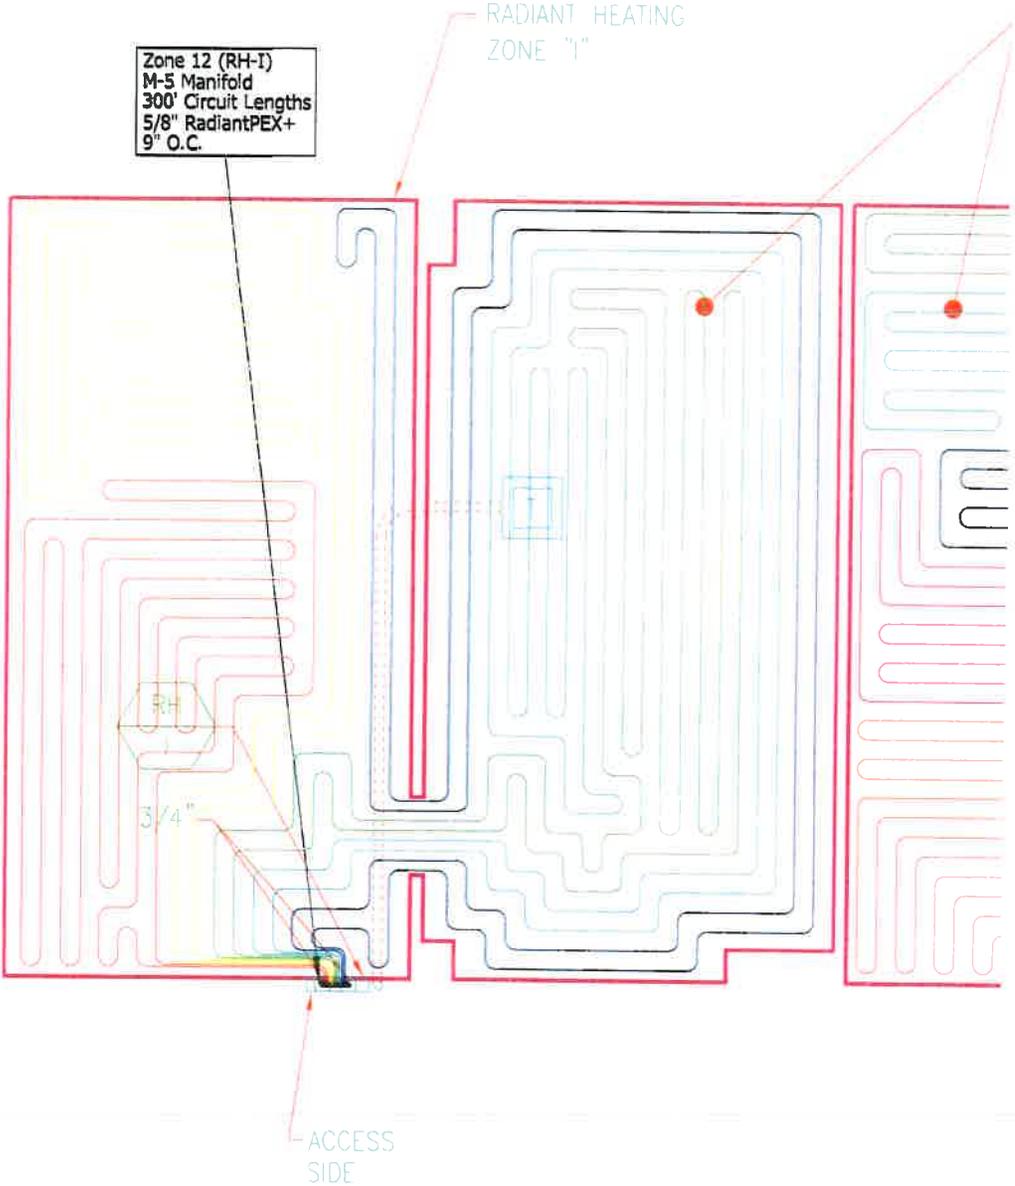


Room 2227

FOR TUBING
EMBEDMENT
REFER TO



RADIANT HEATING
ZONE "M"

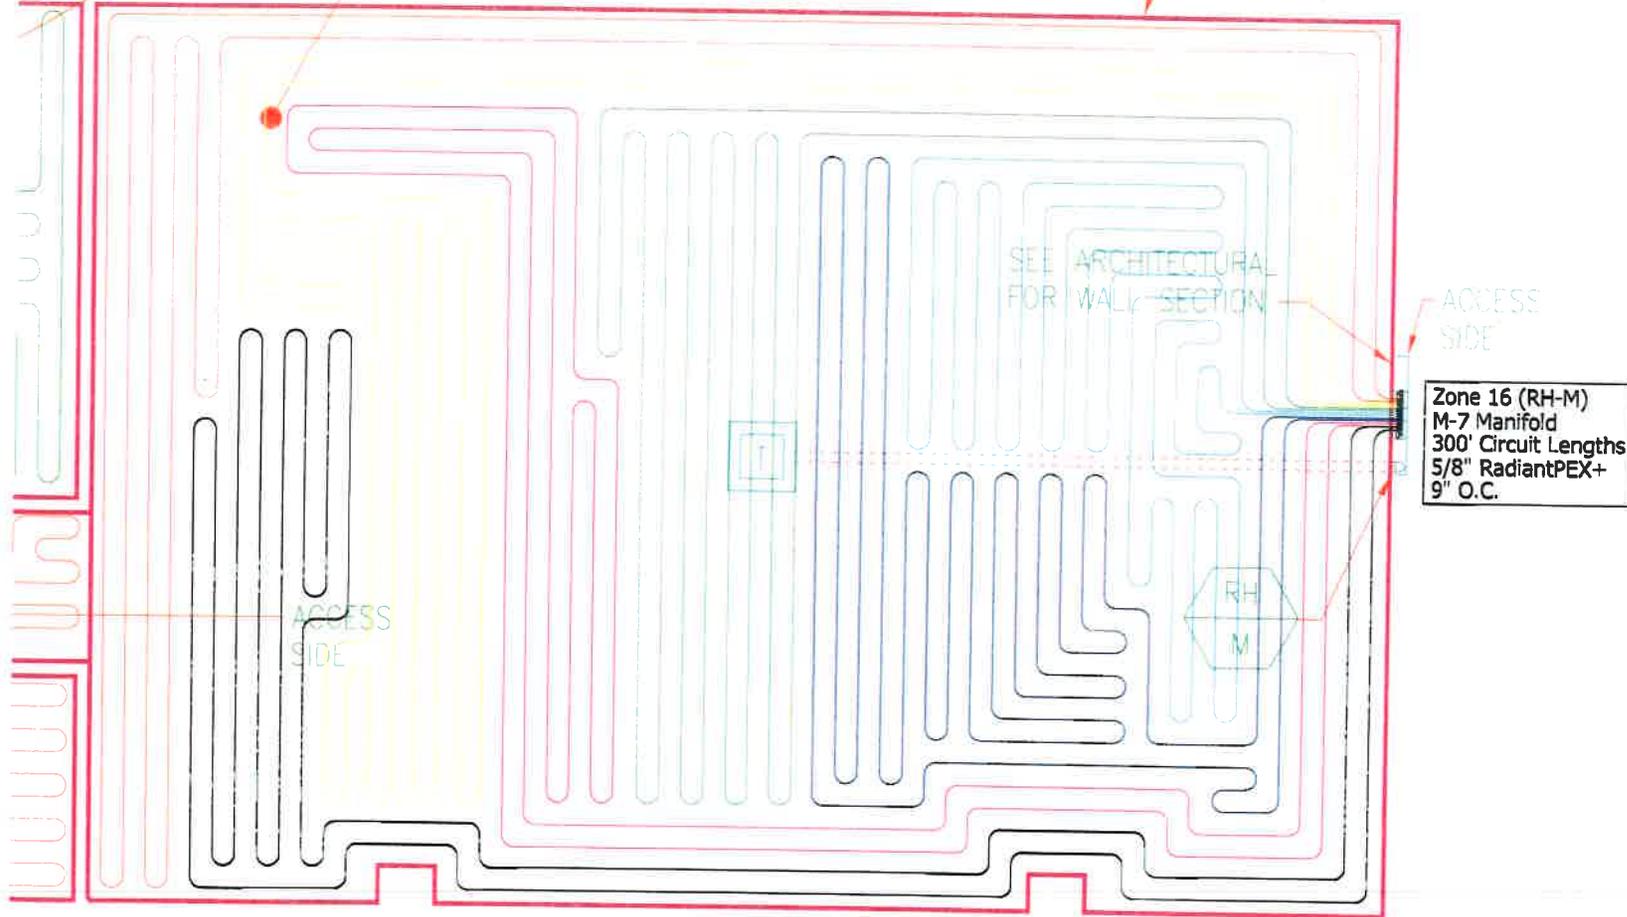

SEE ARCHITECTURAL
FOR WALL SECTION

ACCESS
SIDE

Zone 16 (RH-M)
M-7 Manifold
300' Circuit Lengths
5/8" RadiantPEX+
9" O.C.

ACCESS
SIDE

RH
M

