



HTG 10

HTG 7

HTG 11

E + W
S

CAUTION
SLIPPERY WHEN WET



MAINTENANCE
TAG NUMBER
072A-DT-2
OMVA Facilities Mgmt. Office
With CMSP
Maintenance Management System

HOT WATER HEATER

F 0 2



MAINTENANCE
TAG NUMBER
OTZA-DT-2

MAINTENANCE
TAG NUMBER
OTZA-CP-7

CP-7

MSDS
LIST
ENCLOSED

WARNING
AVOID
NO FLAME
NO SPARK

WARNING
AVOID
NO FLAME
NO SPARK

WARNING
AVOID
NO FLAME
NO SPARK

Webster

LCP-1



RETURN TEMP.

BLR #1 BURN FAIL. BLR #2 BURN FAIL. BLR #3 BURN FAIL.

LO PRESS. BLR. HDR. NO FLO. BLR. HDR.

LO WATER BLR. HDR. HI TEMP. BLR. HDR.

HI FUELOIL TANK WATER STG. ROOM LO FUELOIL TANK WATER STG. ROOM

HI FUELOIL TANK BOILER ROOM LO FUELOIL TANK BOILER ROOM

PUSH TO TEST PUSH TO RESET

HORN

POWER

BOILER #1
H - O - A

BOILER #2
H - O - A

BOILER #3 STANDBY
OFF ON

CP-4 ZONES
H - O - A

CP-5 STANDBY
H - O - A

CP-6 FANROOM #216
H - O - A

CP-2 STANDBY
H - O - A

CP-3 CRAWLSPACE
H - O - A

BLR. #1 BURN FAIL.

BLR. #2 BURN FAIL.

BLR

LO PRESS. BLR. HDR.

NO FLO BLR. HDR.

LO WATER BLR. HDR.

HI TEMP. BLR. HDR.

HI FUEL OIL TANK
WATER STG. ROOM

LO FUEL OIL TANK
WATER STG. ROOM

LO FUEL OIL TANK





FIREBOX DRAFT

WEIL-McLAIN

870309AK


INSPECTION TAG
870309AK
SCOTT LANE
10/23/05 10:23 AM




MAINTENANCE
TAG NUMBER
CTZA-5-4
AK DMVA Facilities Mgmt. Div.
THE CHSD
Maintenance Delivery System

870309-A

WEIL-McLAIN
HOT FIRE ALARM
870309-A
10/23/05 10:23 AM

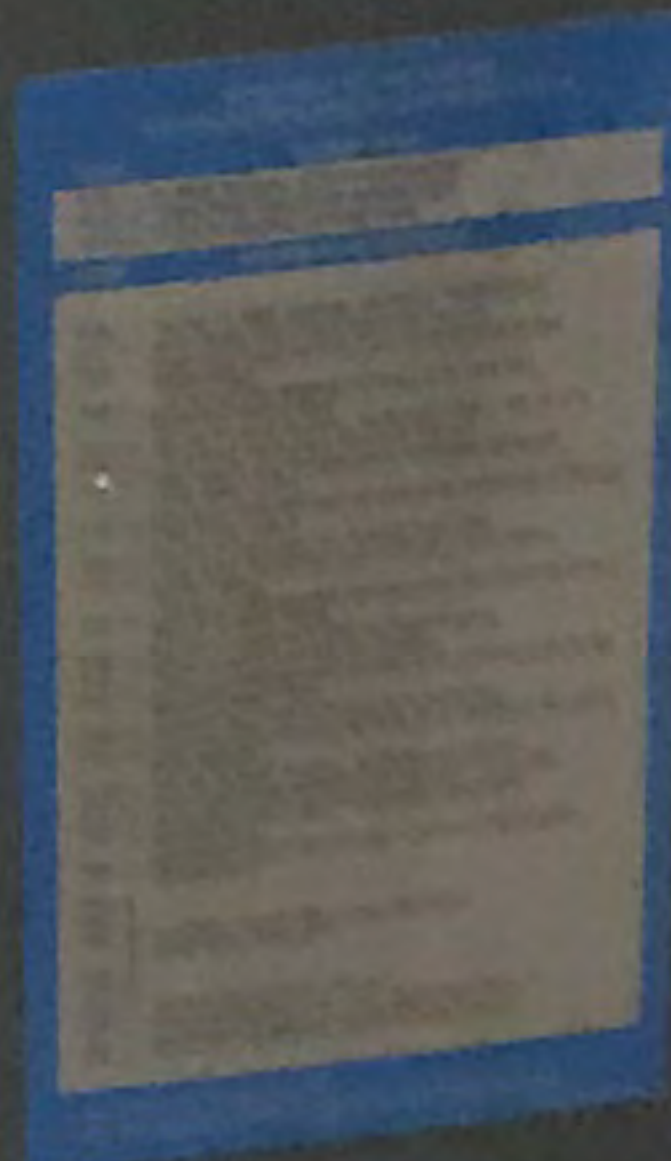

LOW FIRE
SWITCH

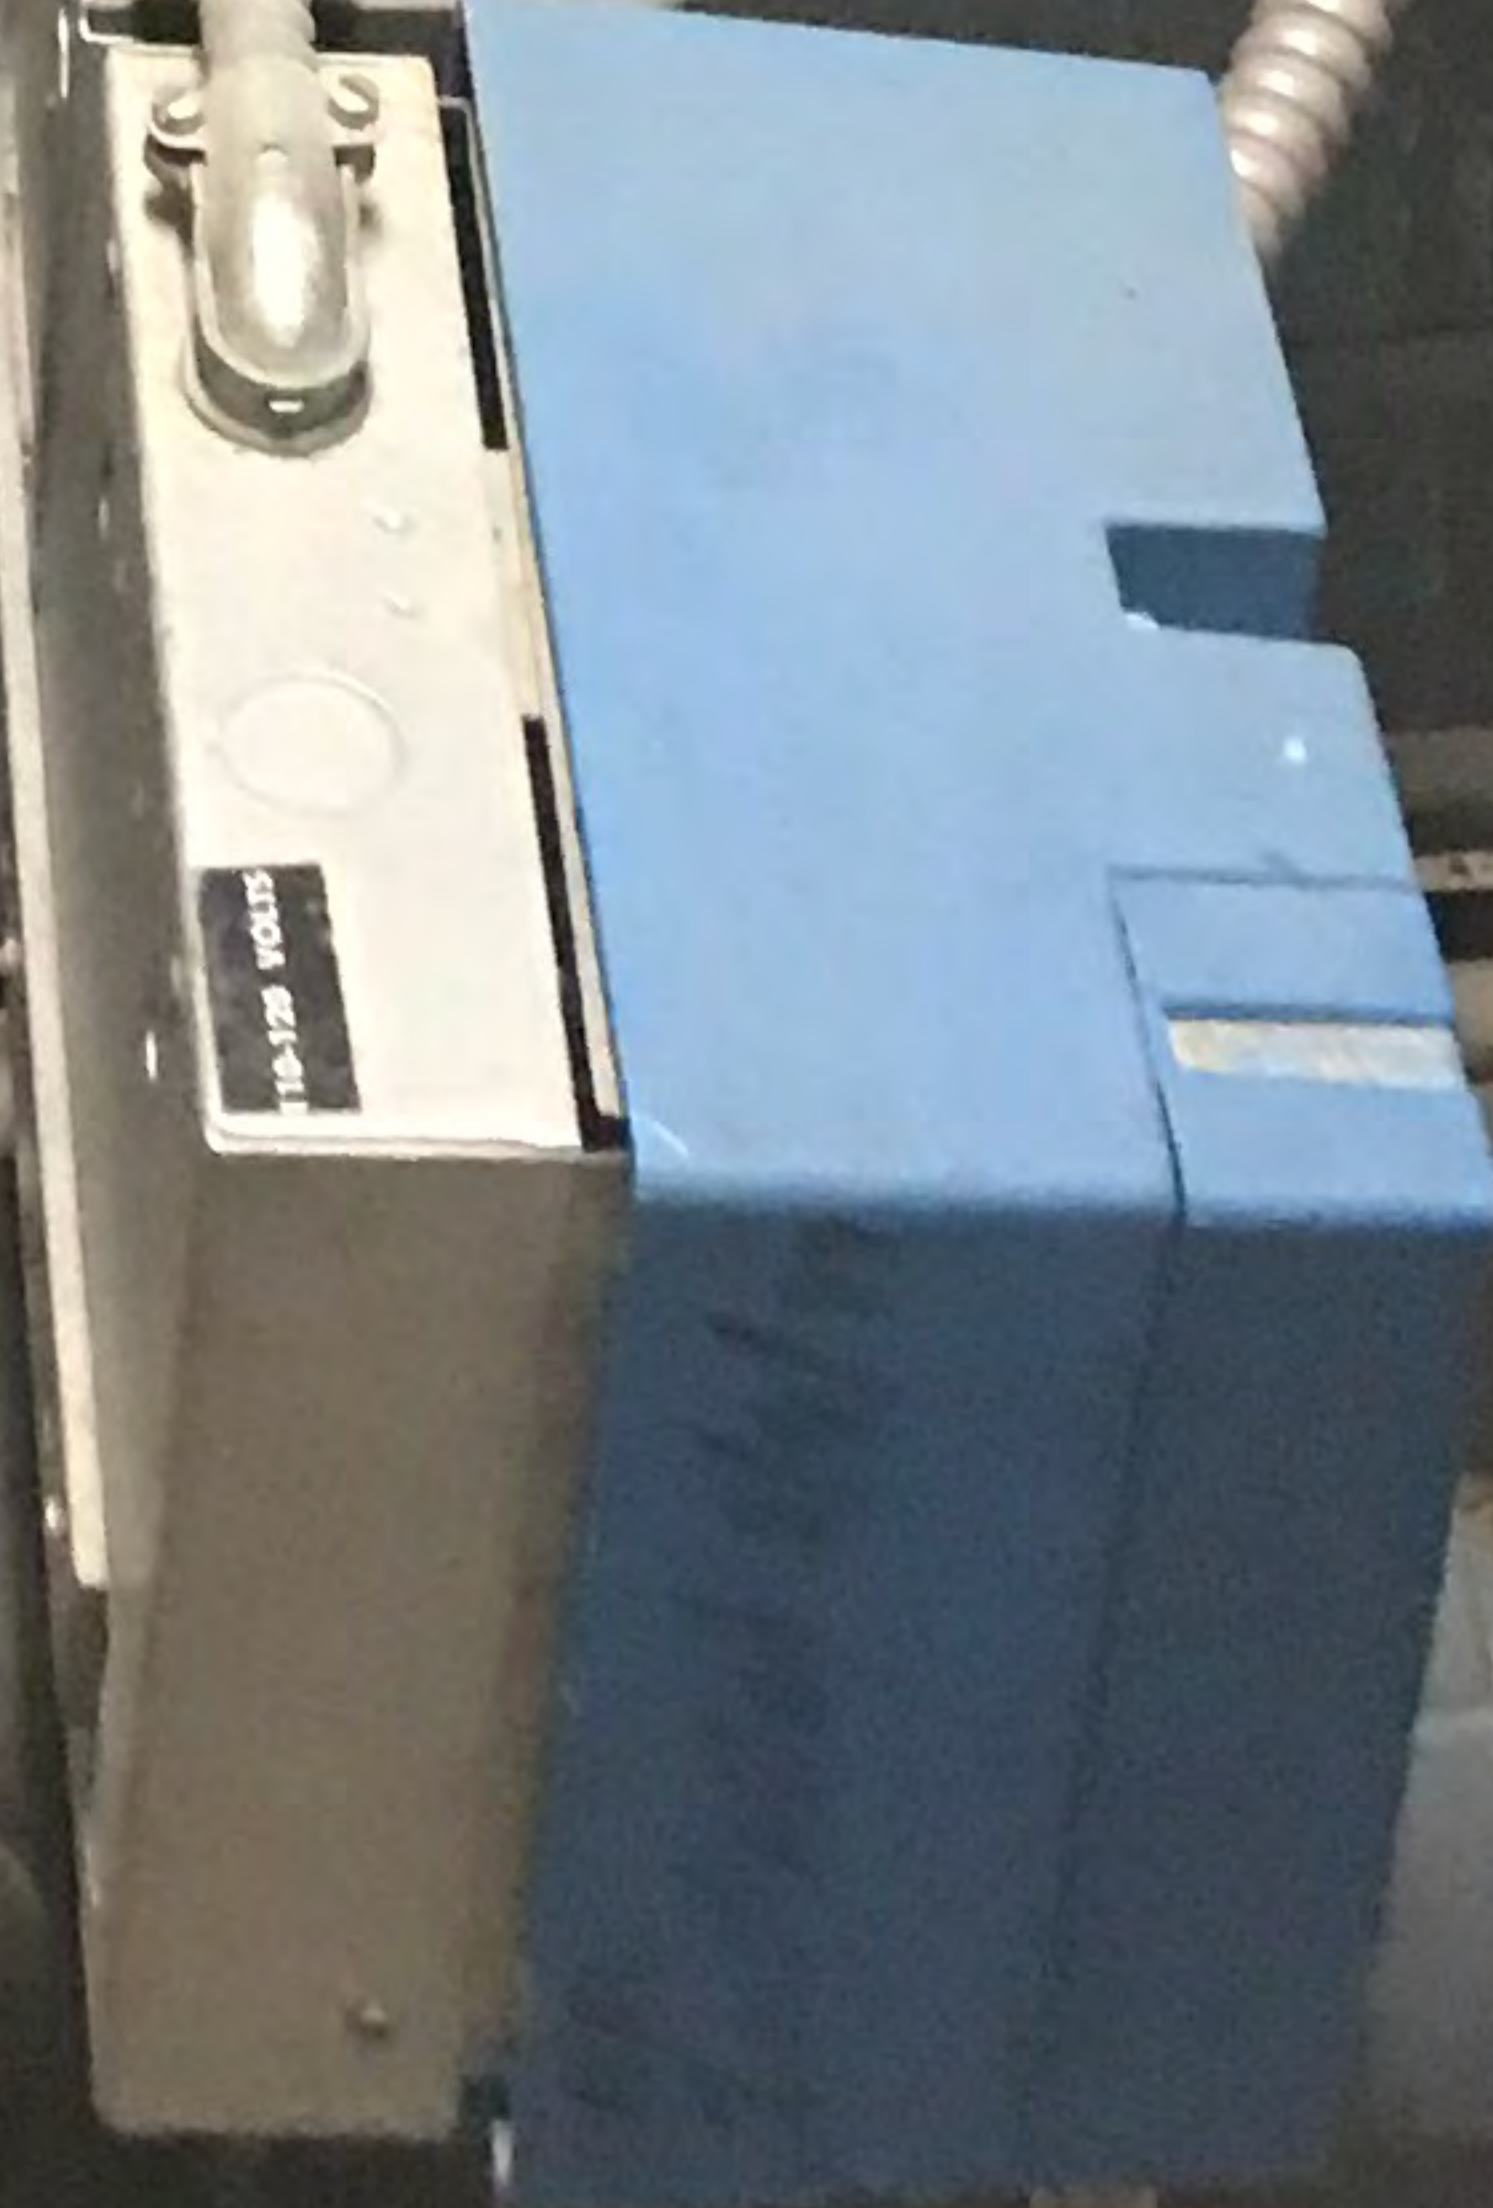



















FILL PORT

HEATING OIL ONLY

NO SMOKING
WITHIN 50 FEET



NO SMOKING
WITHIN 50 FEET

ANCHORA
TANK
SECONDARY
CONTAINMENT

3000