



State of Alaska
Department of Environmental Conservation
Village Safe Water Program

555 Cordova Street
Anchorage, AK 99501
Evan.patterson@alaska.gov

March 24, 2022

To: Vendor List

Re: Amendment 4
ITB 22-VSW-UNK-039
Pipe Order
ITB Due Date: March 30, 2022 @ 2:00 PM AST


The following changes are required:

1. Bidders shall disregard Project Drawings issued with Amendment 1 titled "80903.00 Unalakleet Water Source IFC Drawings". These shall be replaced with the attached pipe sketches (2 pages) dated 3/23/2022.
2. The ITB bid schedule has been updated. Bidders shall use the attached updated bid schedule when submitting their bid.

The following are vendor questions and the department's response:

1. Vendor: I am working on this ITB for us and had a few questions on the bid schedule if you could clarify?
 - Bid Schedule Item A – 6" x 18" HDPE Jacketed Arctic Pipe

- This would be **Detail 1 Raw Water Pipe** shown below with 18" HDPE outer jacket and 6" HDPE Raw Water Pipe
- Bid Schedule Item C – 6" x 15" HDPE Jacketed Arctic Pipe
 - This would be **Detail 1 Raw Water Pipe** shown below but with 15" HDPE outer jacket and 6" HDPE Raw Water Pipe?
- Bid Schedule Item F – 6" x 15" Aluminum Jacketed Arctic Pipe
 - This would be **Detail 2 Raw Water Service Pipe** with 15" Aluminum outer jacket and 4" HDPE carrier pipe/2" HDPE main pipe – per the note in the table for "Raw Water Well Line"?
- Bid Schedule Item G – 6" x 18" Aluminum Jacketed Arctic Pipe
 - This would be **Detail 2 Raw Water Service Pipe** with 18" Aluminum outer jacket and 6" HDPE carrier pipe/2" HDPE main pipe – per the note in the table for "Raw Water Main (Above Grade)"

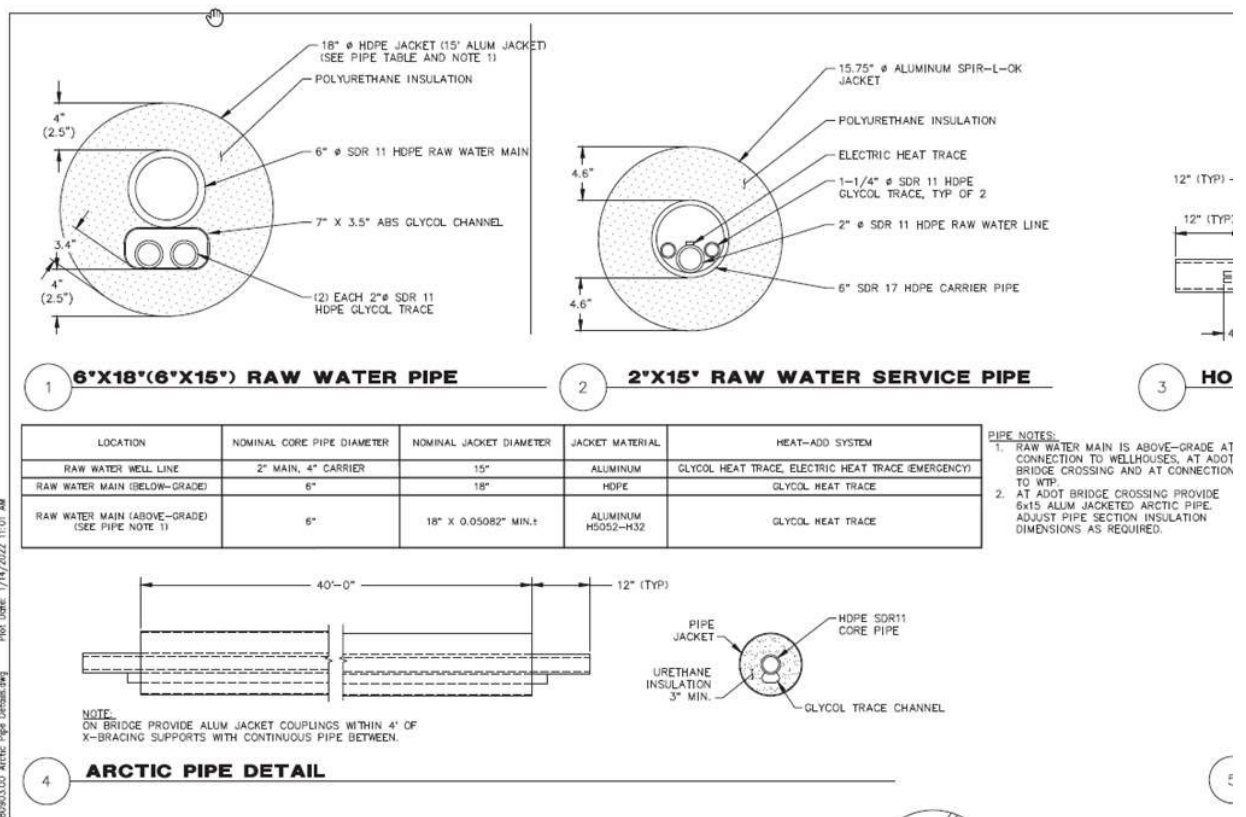

Department: Please see attached pipe sketches and bid schedule.

Evan Patterson

Evan Patterson

Procurement Specialist



3940 Arctic Blvd. • Suite 300
Anchorage, Alaska 99503
(907) 562-3252 FAX 561-2273

JOB UNK

SHEET NO. 1 of 2

OF


CALCULATED BY KRH

DATE 3/23/22


CHECKED BY

DATE

SCALE NTS

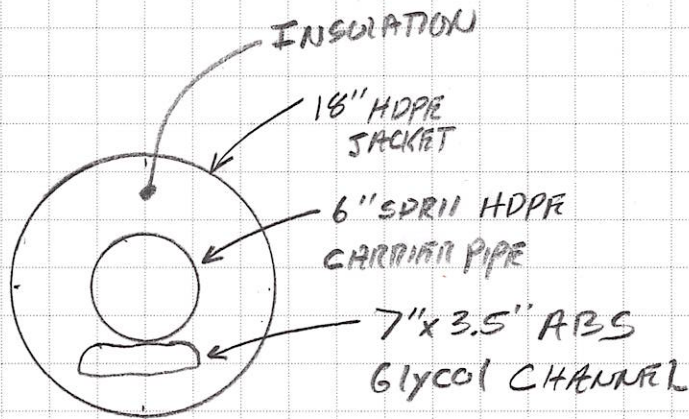

BID SCHEDULE ITEM A

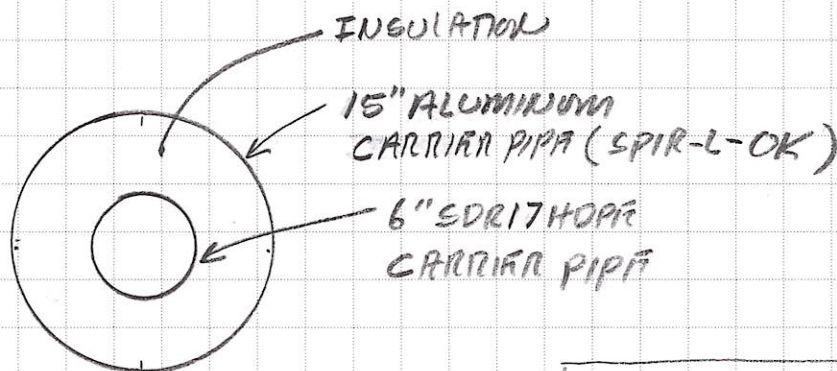

BID SCHEDULE ITEM C

NOTE: RE-NAME BID ITEM C
TO 6x15 ALUMINUM
SACKETED ARCTIC PIPE.



3940 Arctic Blvd. • Suite 300
Anchorage, Alaska 99503
(907) 562-3252 FAX 561-2273

JOB UNK

SHEET NO. 2 of 2

OF


CALCULATED BY KRH

DATE 3/23/22


CHECKED BY

DATE

SCALE NTS

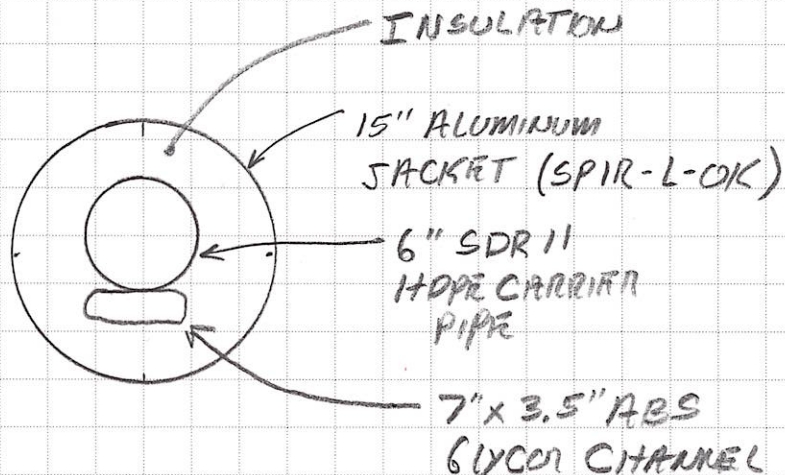

BID SCHEDULE ITEM F

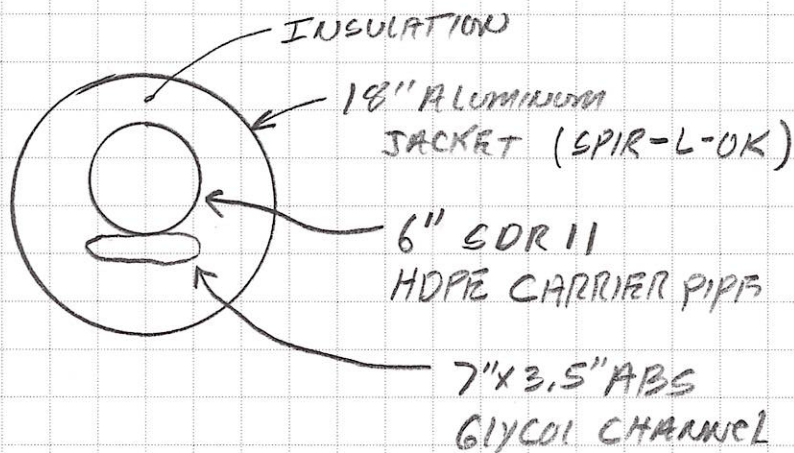

BID SCHEDULE ITEM G

BID SCHEDULE – Amendment 4

Item	Description	Quantity	Unit	Unit Price	Extended Price
A	6" x 18" high density polyethylene (HDPE) jacketed arctic pipe per specification 33 11 13 and 33 90 10.	13,280	Feet	\$	\$
B	2" standard dimension ratio (SDR) 11 bare HDPE pipe per specification 33 11 13 and 33 90 10.	27,500	Feet	\$	\$
C	6" x 15" aluminum jacketed arctic pipe per specification 33 11 13 and 33 90 10.	320	Feet	\$	\$
D	1-1/4" SDR 11 bare HDPE pipe per specification 33 11 13 and 33 90 10.	500	Feet	\$	\$
E	2" SDR 11 bare HDPE pipe per specification 33 11 13 and 33 90 10.	300	Feet	\$	\$
F	6" x 15" aluminum jacketed arctic pipe per specification 33 11 13 and 33 90 10.	440	Feet	\$	\$
G	6" x 18" aluminum jacketed arctic pipe per specification 33 11 13 and 33 90 10.	240	Feet	\$	\$
H	Shipping to F.O.B. Point	Lump Sum			\$
I	Total Unadjusted Bid Amount (Items A thru H = I)				\$
J	MBE/WBE Preference (5% of I), or blank (\$0) if not applicable.				\$
K	Total Adjusted Bid Amount for evaluation purposes only (I-J = K)				\$

Bidders may complete the following:

Non-mandatory As-needed Order: (see section 2.10): The bidder is able to hold bid item (except shipping) unit costs firm until date [_____].