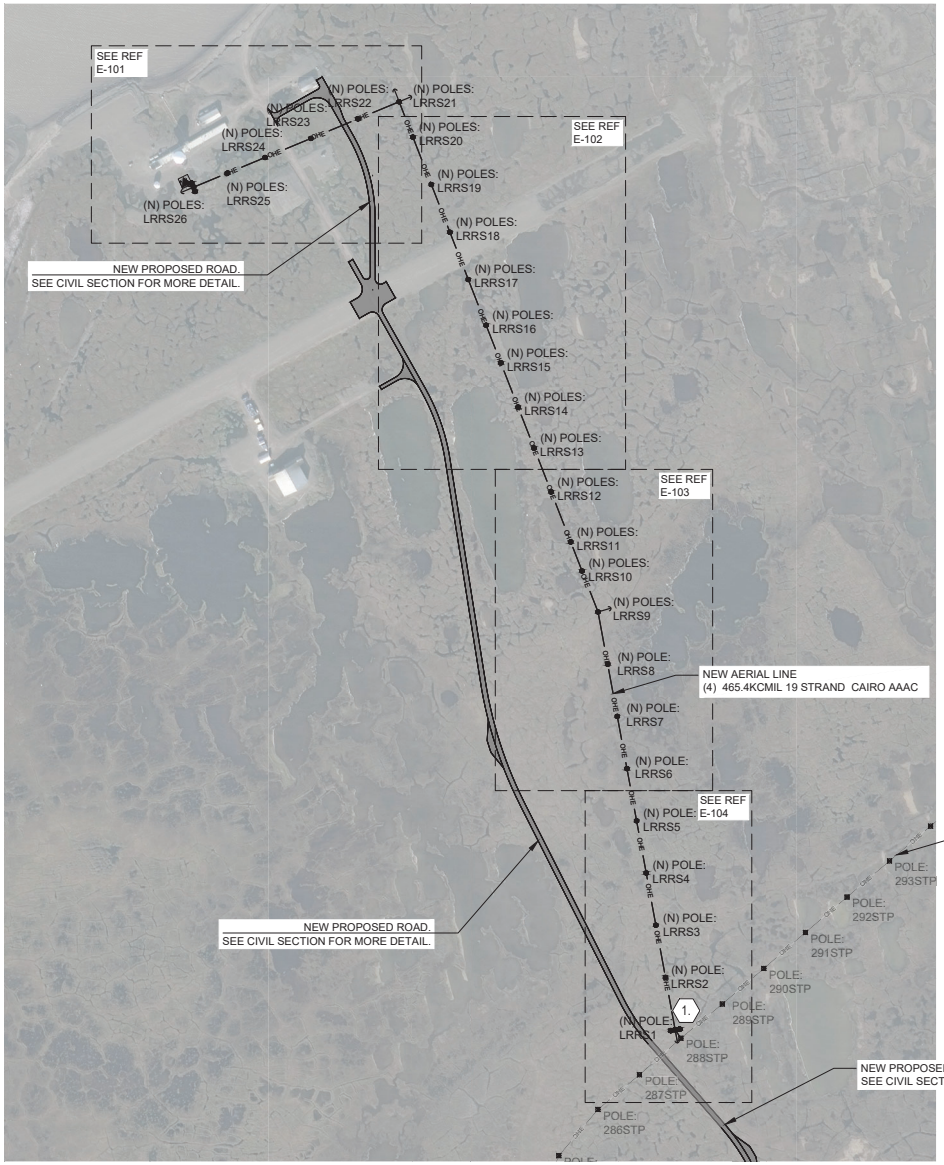

A1 SITE ELECTRICAL DESIGN OVERVIEW
SCALE: 1" = 300'

SHEET NOTES (#)

1. CONOCOPHILLIPS SHALL PERFORM THE FINAL CONNECTION ON POLE LRRS1 AND THEIR EXISTING AERIAL LINES.
2. GOVERNMENT AND CONOCOPHILLIPS SHALL BE PROVIDED ACCESS ALONG THE NEW POWER LINES FOR INSPECTION OF THE NEW POWER LINES VIA VEHICLES AND DRONES. ALL COORDINATION WITH CONOCOPHILLIPS WILL BE THROUGH THE GOVERNMENT.

0 300' 600'

US Army Corps of Engineers ® Alaska District

MARK	DESCRIPTION	DATE

U.S. ARMY CORPS OF ENGINEERS
ALASKA DISTRICT
2204 3RD STREET
JBER, ALASKA 99506-0898

DESIGNED BY: Z.SAM
DRAWN BY: Z.SAM
CHECKED BY: R. RO
SUBMITTED BY: I.VALDEZ-PENA
SIZE: ANSI D

ISSUE DATE: 10 JULY 2024
SOLICITATION NO.: W912DQ-24-B-0001
CONTRACT NO.:
DRAWING #: AK-465-101-01
OL002
FILE: OL002_E_100.dwg

SWMX0097
OLIKTOK LRRS, AK
REPAIR OLIKTOK ROAD
ELECTRICAL
PLANS
SITE PLAN OVERVIEW

REFERENCE NUMBER:
E-100

100%