

**STATE OF ALASKA ITB NUMBER 25SWS0820B
AMENDMENT NUMBER TWO**

RETURN THIS AMENDMENT TO THE ISSUING OFFICE AT:



Department of Public Safety
Division Administrative Services
Address 5700 E Tudor Road
Anchorage, AK 99507

THIS IS NOT AN ORDER

DATE AMENDMENT ISSUED: February 2, 2026

ITB TITLE: Palmer Courthouse Bi-Directional Amplifier

Amendment One: Issued to provide an additional bid document and answer vendor-submitted questions.

ITB OPENING DATE AND TIME: February 12, 2026 at 2:30 PM Alaska Time.

This is an informational amendment.

Questions Submitted by Vendors

Question 1: Can the donor antenna be placed at the preferred location on the gable peak closest to comm room in Clerk's Office?

Answer: Yes, but keep the feed line hidden beneath the roof line. There is a hatch in the clerks office that allows access to that part of the roof. Install weather head or similar weather proofing for penetration protection.


Question 2: Does the transmission line for the DAS need to be placed in conduit?

Answer: No. As long as the cable is plenum rated, no conduit will be required.

Question 3: Our Engineers reviewed this updated floor plan, but it seems to be missing the basement, the lot/penthouse, and the roof. Can those please be included?

Answer: The only additional drawing available in electronic form is for the basement (attached).

PALMER
COURTHOUSE
BASEMENT
PLAN

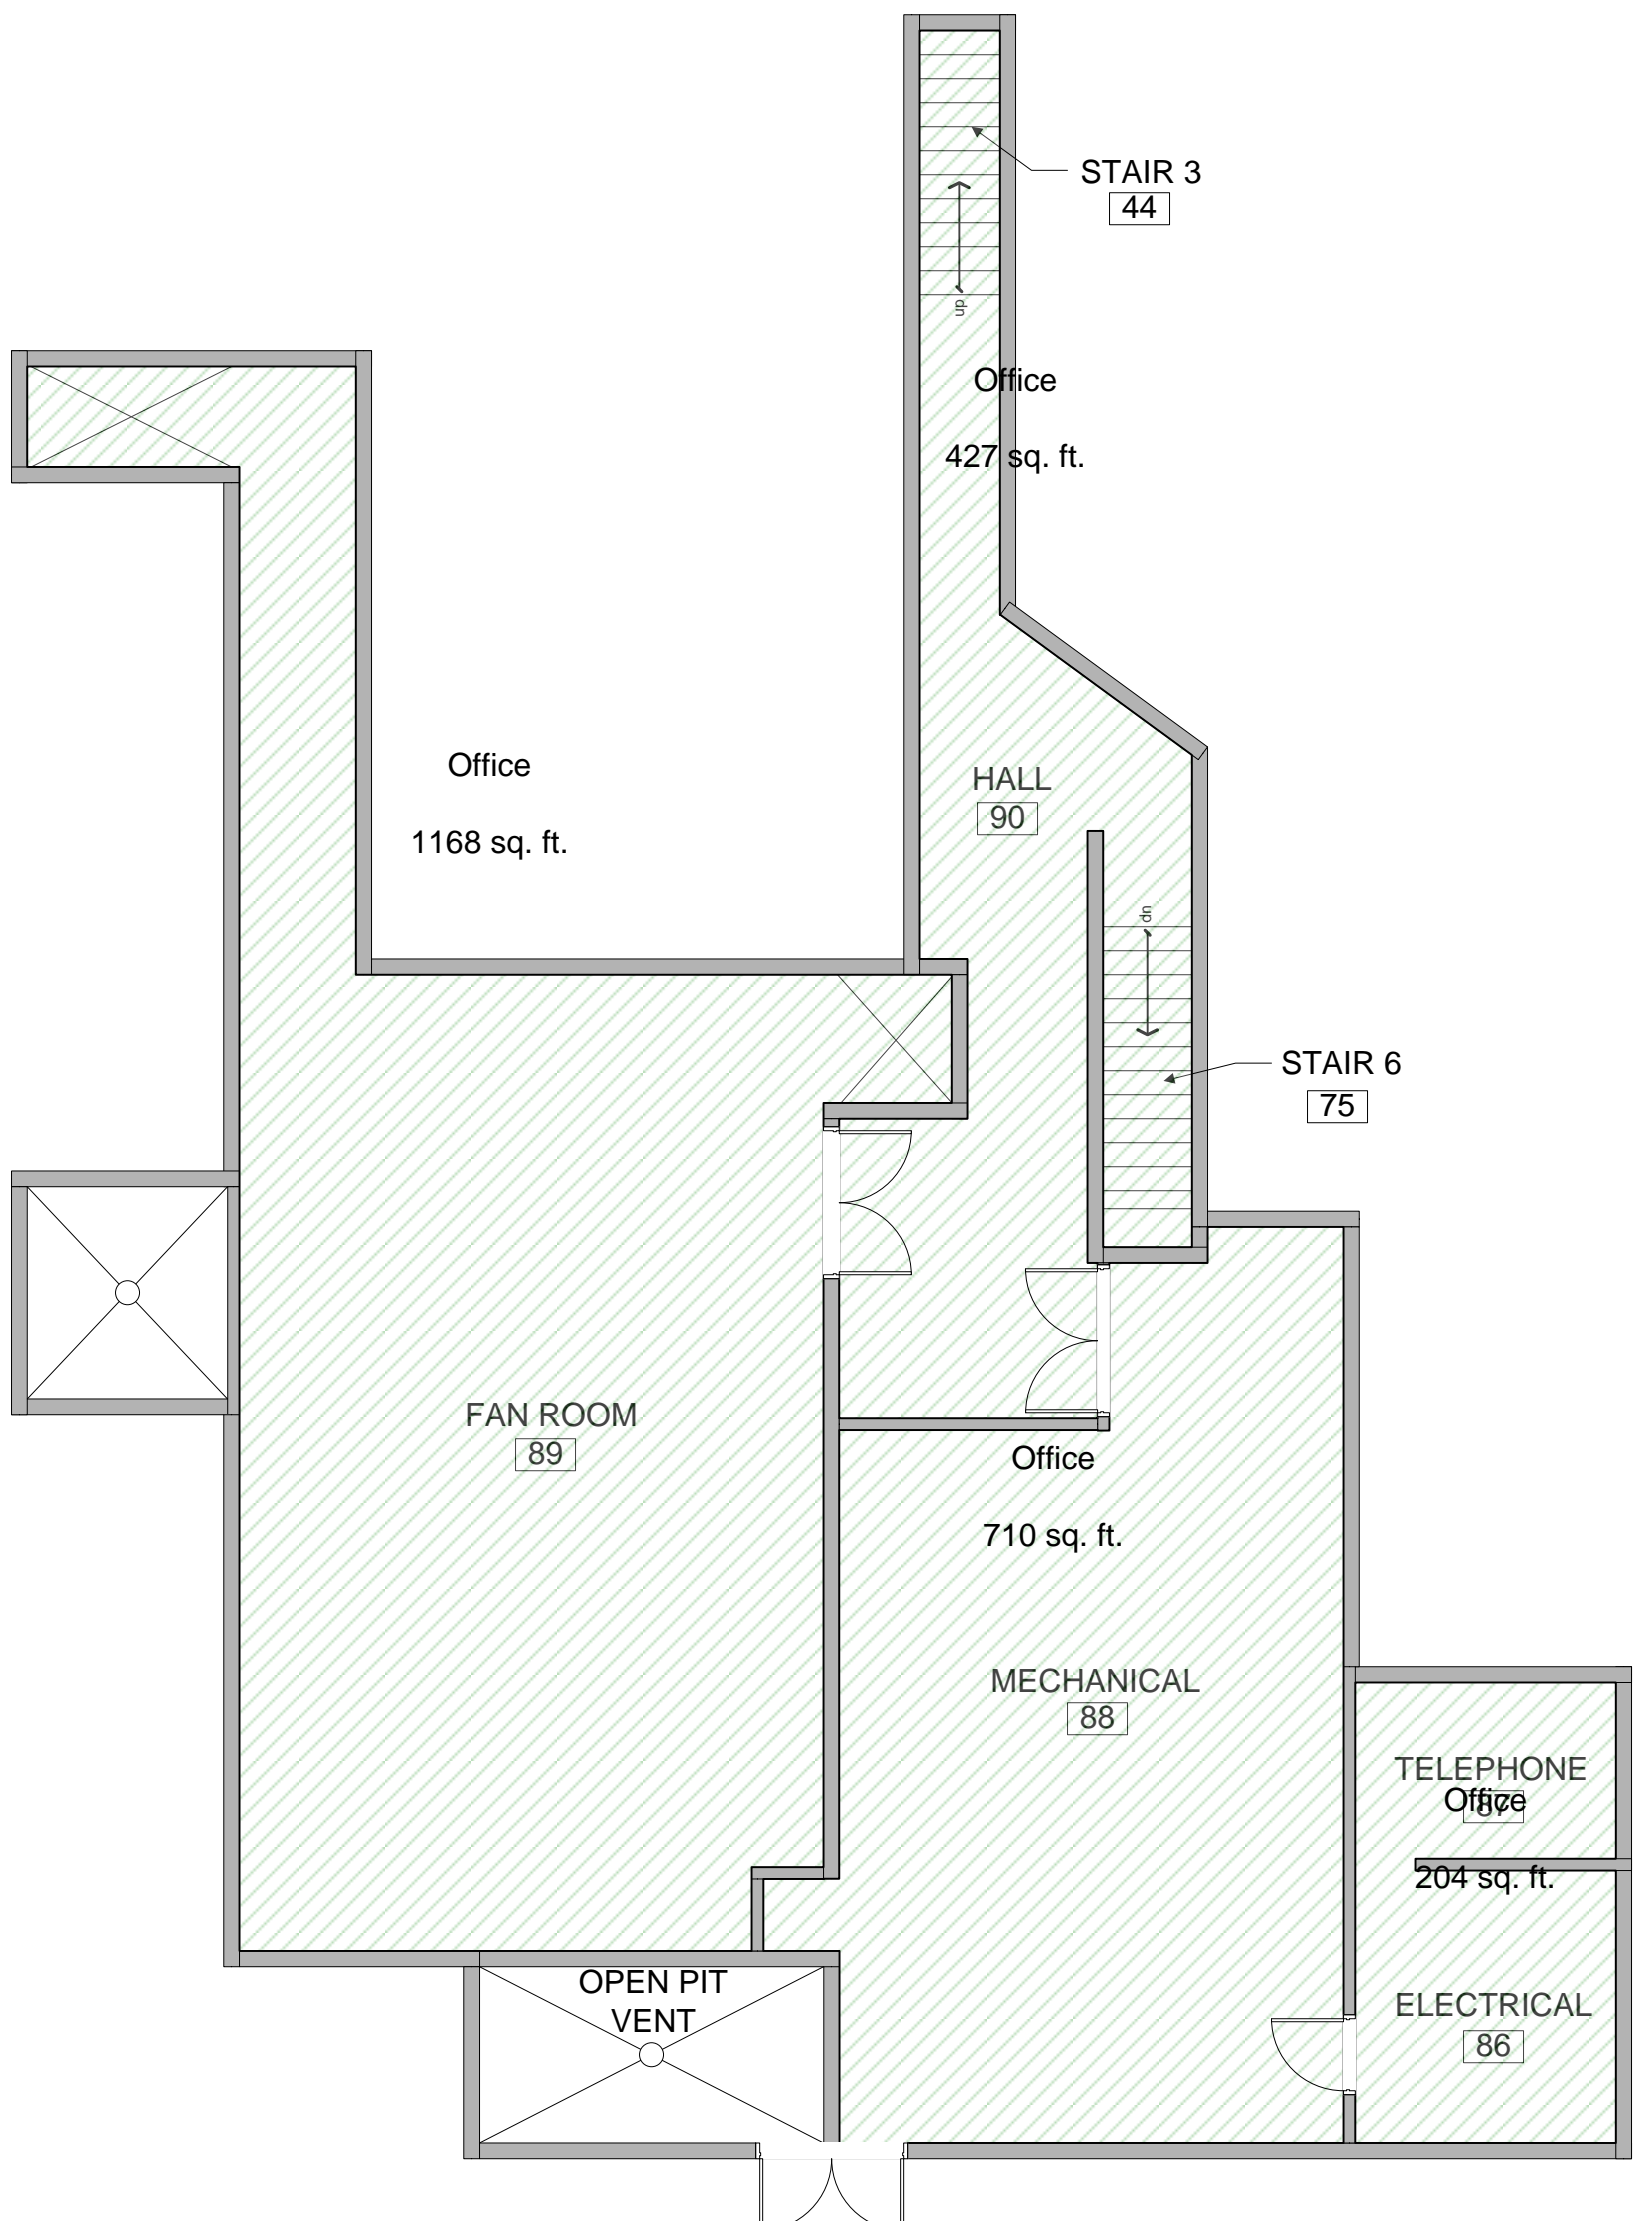

Basement SF
Area: 2,509